



Arkansas Department of Health

Drinking Water Program

Annual Report

Public Water System Supervision Program

Calendar Year 2025

Arkansas Department of Health
4815 West Markham Slot-37
Little Rock, AR 72203-1437

Contact:
Teresa Lee
Managing Engineer
Telephone (501) 661-2623
Fax (501) 661-2032
Teresa.Lee@arkansas.gov

Table of Contents

ABBREVIATIONS AND DEFINITIONS	3
INTRODUCTION	4
Arkansas Land Use	4
Characteristics of Arkansas's Water Systems	4
PURPOSE	4
THE STATUTORY ORIGIN	5
ACCESSIBILITY TO PUBLIC	5
SUMMARY OF VIOLATIONS	6
DEVIATION FROM FEDERAL DATABASE	8
VIOLATIONS TABLES: CHEMICAL CONTAMINANTS	9
VIOLATIONS TABLES: TOTAL COLIFORM RULE & REVISED TOTAL COLIFORM RULE	10
VIOLATIONS TABLES: SURFACE WATER TREATMENT/GROUNDWATER/INTERIM ENHANCED	11
VIOLATIONS TABLES: LEAD & COPPER RULE	12
CONSUMER NOTIFICATION: CONSUMER CONFIDENCE REPORTS & PUBLIC NOTIFICATION	12
VIOLATIONS TABLES: RADIONUCLIDES	13
DEFINITIONS FOR THE VIOLATIONS TABLES	14
VARIANCES AND EXEMPTIONS	17
ENFORCEMENT DEFINITIONS	18
SUMMARY OF ENFORCEMENT ACTIONS	19
Community Public Water Systems	19
Non-Transient Non-Community Systems	19
Transient Non-Community Systems	19
COMPLIANCE ASSISTANCE EFFORTS	20
Capacity Development Program	20
Area Wide Optimization Program	20
Sanitary Survey	21
Industry Education	21
Source Water Assessment Plan	22
Cross Connection Control Program	22
Comprehensive Performance Evaluations	23
Microbial / Disinfection Byproduct Rules Programs	23
Ground Water Rule	24
Technical Assistance and Training	25
Water Operator Licensing and Training	26
VIOLATIONS BY TYPE OF SYSTEM GRAPH	27
ENFORCEMENT ACTIONS BY TYPE OF SYSTEM GRAPH	28
APPENDICES	29
APPENDIX A – MICROBIOLOGICAL MAXIMUM CONTAMINANT LEVEL VIOLATIONS	30
APPENDIX B – MICROBIOLOGICAL MONITORING / NO VALID SAMPLES	31
APPENDIX C – MICROBIOLOGICAL MONITORING / FAILURE TO COLLECT ASSESMENT SAMPLES	37
APPENDIX D – SURFACE WATER TREATMENT RULE MONITORING	38
APPENDIX E – SURFACE WATER TREATMENT RULE TREATMENT TECHNIQUE	39
APPENDIX F – CHEMICAL MAXIMUM CONTAMINANT LEVEL VIOLATION	40
APPENDIX G – RADIUM MAXIMUM CONTAMINANT LEVEL VIOLATION	45
APPENDIX H – LEAD & COPPER RULE MONITORING & TREATMENT TECHNIQUE	46
APPENDIX I – NO VIOLATIONS FOR THIS CALENDAR YEAR	50
APPENDIX J – ENFORCEMENT ACTIONS	67
APPENDIX K – PUBLIC NOTICE VIOLATIONS	71
APPENDIX L – CONSUMER CONFIDENCE REPORT VIOLAIONS	76

ABBREVIATIONS AND DEFINITIONS

ADH	Arkansas Department of Health
ARWA	Arkansas Rural Water Association
AWOP	Area Wide Optimization Program
CCCP	Cross-Connection Control Program
CCR	Consumer Notification
CDP	Capacity Development Program
CPE	Comprehensive Performance Evaluations
CY	Calendar Year
DBPR	Disinfectants and Disinfection Byproducts Rule
EPA	Environmental Protection Agency
GWR	Ground Water Rule
HAA	Total Haloacetic Acids
LT2ESWTR	Long Term 2 Enhanced Surface Water Treatment Rule
MCLs	Maximum Contaminant Levels
OEL	Operational evaluation level
OIT	Operator-In-Training
PWS	Public Water Systems
RTCR	Revised Total Coliform Rule
SDWIS	Safe Drinking Water Information System
SDWA	Safe Drinking Water Act
SOC	Synthetic Organic Compounds
SWAP	Source Water Assessment Program
SWTR	Surface Water Treatment Rule
TT	Treatment Technique
TTHM	Total Trihalomethanes
VOC	Volatile Organic Compounds
PWS Types	Community (C), Transient Non-Community (N) Non-Transient Non-Community (NTNC) Bottler (B) Vending Machine (V)

INTRODUCTION

Arkansas Land Use (2025 U. S. Census Bureau Estimate)

Total area of Arkansas	34,036,672 acres
Total area of land	33,328,192 acres
Total area of water	708,480 acres
Total area of forest	15,950,000 acres
Total area of arable land	7,295,000 acres
Total area of wetland	820,619 acres
Total area of barren land	42,000 acres
Total area of developed land	205,340 acres

Characteristics of Arkansas's Water Systems

Population of Arkansas (2025 U. S. Census Bureau Estimate) 3,114,791

Population served by public water systems	3,098,008
Population served by surface water systems	2,127,969
Population served by ground water systems	782,207
Population served by ground & surface systems	187,,832

% population served by community public water systems	99.4%
% population served by individual private wells or other source	0.6%

Total number of public water systems active during 2025 1013

Number of community public water systems	660
Number of transient non-community public water systems	325
Number of non-transient non-community public water systems	28

Number of systems using surface water	419
Number of systems using ground water	558
Number of systems using ground & surface	36

PURPOSE

The purpose of this report is to summarize the Arkansas Public Water System violation data submitted to the Safe Drinking Water Information System (SDWIS/FED) for the calendar year 2025. The data includes PWS inventory statistics, the incidence of Maximum Contaminant Level, Major Monitoring, and Treatment Technique violations, and the enforcement actions taken against violators. The report provides a total annual representation of the numbers of violations for each of the four categories listed in Section 1414(c)(3) of the Safe Drinking Water Act reauthorization. These four categories include MCLs, treatment techniques, variances and exemptions, and significant monitoring violations.

STATUTORY ORIGIN

The EPA established the Public Water System Supervision (PWSS) Program under the authority of the 1974 Safe Drinking Water Act (SDWA). Under the SDWA and its 1986 and 1996 Amendments, EPA sets national limits for contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as Maximum Contaminant Levels (MCLs). For some regulations, EPA establishes treatment techniques in lieu of MCLs to control unacceptable levels of contaminants in water. The EPA also regulates how often public water systems (PWSs) monitor their water for contaminants and requires the monitoring results to be reported to the States and/or EPA. Generally, the larger the population served by a water system, the more frequent the monitoring and reporting (M/R) requirements. In addition, EPA requires PWSs to monitor for unregulated contaminants to provide data for future regulatory development. Finally, EPA requires PWSs to notify the public when they have violated these regulations. The 1996 Amendments to the SDWA require public notification to include a clear and understandable explanation of the nature of the violation, its potential adverse health effects; steps that the PWS is undertaking to correct the violation and the possibility of alternative water supplies during the violation.

The SDWA applies to the 50 States, the District of Columbia, Indian Country, Puerto Rico, the Virgin Islands, American Samoa, Guam, the Commonwealth of the Northern Mariana Islands, and the Republic of Palau.

The SDWA allows States and Territories to seek EPA approval to administer their own PWSS Programs. The authority to run a PWSS Program is called primacy. To receive primacy, States must meet certain requirements laid out in the SDWA and the regulations, including the adoption of drinking water regulations that are at least as stringent as the Federal regulations and a demonstration that they can enforce the program requirements. Of the 57 States and Territories, all but Wyoming and the District of Columbia have primacy. The EPA Regional Offices administer the PWSS Programs within these two jurisdictions.

ACCESSIBILITY TO PUBLIC:

The full report will be made available on the Arkansas Department of Health – Engineering Section web site. The address is: <https://healthy.arkansas.gov/programs-services/public-health-safety/drinking-water-safety/epa-drinking-water-annual-compliance-reports/>

1. The notice of availability will be published in the Section's quarterly newsletter. This newsletter reaches all community and non-transient non-community PWS's, consulting engineers, government agencies, nonprofit organizations and other stakeholders interested in public drinking water in the state of Arkansas.
2. A notice of the availability of the report will be provided to all local health units in Arkansas.

Summary of Violations

- No violations occurred during 2025 for contaminants and rules not shown in the violation tables.
- There were 1,013 public water systems in operation during 2025. Six hundred and sixty (660) were community water systems, twenty-eight (28) were non-transient, non-community water systems, and three hundred and twenty-five (325) were transient non-community water systems.
- A total of three hundred and seventy-two (372) major monitoring violations occurred for one hundred and twenty-nine (129) public water systems.
- Two hundred and forty-three (243) violations were for seventy-three (73) community water systems, one hundred and twenty-seven (127) were for fifty-four (54) transient non-community water systems and two (2) for two (2) non-transient, non-community water systems.
- A total of three hundred and eighty-five (385) Maximum Contaminant Level (MCL) or Treatment Technique (TT) violations were issued in 2025 for seventy-three (73) systems. Three hundred and thirty-seven (337) violations for fifty-five (55) community water systems and thirty-four (34) violations for fifteen (15) transient, non-community water systems, fourteen (14) violations for three (3) non-transient non-community water systems.
- No variances or exemptions were issued to any public water system in Arkansas during the calendar year 2025.
- 97.2% of the public water systems in Arkansas did not have an organic (SOC, VOC, TTHM, HAA) MCL violation. All organic MCL violations were for the (TTHM, HAA) analyte group. TTHM, trihalomethanes, and HAA, haloacetic acids, are by products of the disinfection process and decay of naturally occurring organic material such as leaves. The occurrence of these contaminants are largely the result of the use of water sources in forested areas and use of chlorine for disinfection purposes.
- No public water systems in Arkansas had nitrate MCL violations.
- No public water systems in Arkansas exceeded the radium-226/228 MCL or either of the individual MCL's.
- There were no inorganic chemical (MCL) violations issued in 2025.
- There were no monitoring violations for chemicals covered under Phases I, II, IIB, & V. The Arkansas Department of Health performs monitoring of these chemicals on behalf of the public water systems.

- The compliance rate for the contaminants and rules not shown on the violation tables was 100%.
- Using a time and population weighted determination of risk, based on exposure to water that either failed to meet the drinking water standards or which was of unknown quality, Arkansas community water systems achieved the following compliance rates:

	Monitoring	Quality	Overall
Compliance Percentage	99.3	98.5	97.9
Person months exposure	247362	515212	762574
Person months possible	36781368	36781368	36781368

In this calculation, a system serving 100 persons that has one violation lasting one month produces a risk of 100 person months. The total risk possible for this system is 1200 person months (100 persons served multiplied by 12 months). In this example, the compliance rate would be $91.6\% = (1200 - 100) / 1200$.

DEVIATION FROM FEDERAL DATABASE

There were no discrepancies identified between the Federal database (**violation reports for calendar year 2025**) on which the national Annual Compliance Report will be based (Frozen) and the Arkansas state drinking water program database, SDWIS/STATE.

There are no deviations between the Federal Frozen Database and Arkansas's SDWIS/STATE database for the 2025 calendar year reported violations which include.

Revised Total Coliform Rule: (Violation code 1A – *E. coli* MCL)

Revised Total Coliform Rule: (Violation code 2A – Level1 assessment failure or inadequate)

Revised Total Coliform Rule: (Violation code 2B – Level2 assessment failure or inadequate)

Revised Total Coliform Rule: (Violation code 2C - Fail to take corrective action)

Revised Total Coliform Rule: (Violation code 2D - Fail to complete seasonal system start up procedures)

Revised Total Coliform Rule: (Violation code 3A - Fail to collect routine samples)

Revised Total Coliform Rule: (Violation code 3B - Fail to collect additional samples)

Revised Total Coliform Rule: (Violation code 3C – Fail to collect required extra samples/Turbidity)

Revised Total Coliform Rule: (Violation code 3D - Fail to use approved laboratory)

Revised Total Coliform Rule: (Violation code 4D - Fail to notify state within 24 of *E. coli* positive sample)

Revised Total Coliform Rule: (Violation code 4E - Fail to provide state that an *E.coli* MCL violation occurred)

Revised Total Coliform Rule: (Violation code 5A - Fail to submit a sample site plan)

Disinfectant / Disinfection By Products: MCL, Treatment Technique, and Significant Monitoring/Reporting Violations.

Surface Water Treatment (SWTR / IESWTR/GWR): (Violation Code 36 – Filter Monitoring)

Surface Water Treatment (SWTR / IESWTR/GWR): (Violation Code 38 – Monitoring Turbidity)

Surface Water Treatment (SWTR / IESWTR/GWR): (Violation Code 41 – Treatment Techniques)

Surface Water Treatment (SWTR / IESWTR/GWR): (Violation Code 42 – Failure to filter)

Surface Water Treatment (SWTR / IESWTR/GWR): (Violation Code 43 – Treatment tech >Turbidity 1 NTU)

Surface Water Treatment (SWTR / IESWTR/GWR): (Violation Code 44 – Treatment tech >Turbidity 0.3 NTU in more than 5% of monthly CFE samples)

Lead and Copper Rule: Violation codes 51, 52, 66, 58, 65

Radionuclide Rule: MCL violation

Consumer Confidence Reports: violations codes 71, 72

Public Notice Rule (PN): (Violation Code 75 – PN Violation for NPDWR violation)

VIOLATIONS TABLES: CHEMICAL CONTAMINANTS

	SDWIS Codes	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations	Number of Systems with Violations	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
Inorganic Contaminants								
Fluoride	1025	4.0	0/0/0/0	0/0/0/0				
Arsenic	1005	0.010	0/0/0/0	0/0/0/0				
Cyanide	1024		0/0/0/0	0/0/0/0				
ORGANIC CONTAMINANTS								
Tetrachloroethylene	2987		0/0/0/0	0/0/0/0				
Subtotal			0/0/0/0	0/0/0/0				

	SDWIS Codes	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
Disinfectants / Disinfection By-Products								
Stage 1 DBPR	0400				285/277/0/8	25/24/0/1	0/0/0/0	0/0/0/0
Stage 1 DBPR	0999				0/0/0/0	0/0/0/0	10/10/0/0	9/9/0/0
Long Term 2 Enhanced Surface water treatment rule	0999						0/0/0/0	0/0/0/0
Chlorite	1009	1.0	0/0/0/0	0/0/0/0			0/0/0/0	0/0/0/0
Total Haloacetic Acids (HAA5)	2456	0.060	11/11/0/0	6/6/0/0				
Total Organic Carbon	2920				0/0/0/0	0/0/0/0		
Total Trhhalomethanes (TTHM)	2950	0.080	52/52/0/0	22/22/0/0				
Subtotal			63/63/0/0	28/28/0/0	285/277/0/8	25/24/0/1	10/10/0/0	9/9/0/0

T/C/N/P – Total /Community PWS / Transient Non-Community PWS / Non-Transient Non-Community PWS

VIOLATIONS TABLES: TOTAL COLIFORM RULE (TCR) / REVISED TOTAL COLIFORM RULE (RTCR)

TCR / RTCR	SDWIS Codes	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations T/C/N/P	Number of Systems in Violation T/C/N/P	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
RTCR MCL violations	1A	Presence	1/1/0/0	1/1/0/0				
RTCR Treatment Technique	2A				3/2/1/0	3/2/1/0		
RTCR Treatment Technique	2B				0/0/0/0	0/0/0/0		
RTCR Treatment Technique	2C				0/0/0/0	0/0/0/0		
66CR Treatment Technique	2D				4/0/4/0	4/0/4/0		
RTCR monitoring major	3A						166/63/101/2	83/36/45/2
RTCR monitoring minor	3A						46/46/0/0	38/38/0/0
RTCR monitoring major	3B						0/0/0/0	0/0/0/0
RTCR monitoring minor	3B						0/0/0/0	0/0/0/0
TCR monitoring	3C						0/0/0/0	0/0/0/0
RTCR monitoring	3D						1/1/0/0	1/1/0/0
RTCR monitoring	4B						131/128/0/3	46/45/0/1
RTCR Startup procedures	4C						0/0/0/0	0/0/0/0
RTCR notification positive	4D						0/0/0/0	0/0/0/0
RTCR corrective action	4F						0/0/0/0	0/0/0/0
RTCR notification or MCL	4E						0/0/0/0	0/0/0/0
RTCR NOTIFY L1/L2 TT VIO,	4F						0/0/0/0	0/0/0/0
9TCR reporting	4G						0/0/0/0	0/0/0/0
RTCR sample site plan errors	5A						22/22/0/0	6/6/0/0
RTCR record keeping	5B						0/0/0/0	0/0/0/0
Subtotal			1/1/0/0	1/1/0/0	7/2/5/0	7/2/5/0	366/260/101/5	174/126/45/3

VIOLATIONS TABLES: SURFACE WATER TREATMENT RULE(SWTR) / GROUND WATER RULE / INTERIM ENHANCED(SWTR)

	SDWIS Codes	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations	Number of Systems with Violations	Number of Violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
TR/GWR/Interim Enhanced								
<u>Filtered Systems</u>								
Monitoring, routine/repeat	36						0/0/0/0	0/0/0/0
Monitoring, routine/filter turbidity	38						0/0/0/0	0/0/0/0
Treatment techniques	41				2/2/0/0	1/1/0/0		
Failure to filter	42				9/0/8/1	4/0/3/1		
Treatment Tech > Turb 1 NTU	43				1/1/0/0	1/1/0/0		
Treatment Tech > Turb 0.3 NTU	44				1/1/0/0	1/1/0/0		
Subtotal					13/4/8/1	7/3/3/1	0/0/0/0	0/0/0/0

T/C/N/P – Total /Community PWS / Transient Non-Community PWS / Non-Transient Non-Community PWS

VIOLATIONS TABLES: LEAD & COPPER RULE

	SDWIS Codes	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting/Consumer Notice	
			Number of violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
Lead and Copper Rule								
Initial lead and copper tap M/R	51						4/2/0/2	3/2/0/1
Follow-up or routine lead and copper tap M/R	52						23/18/0/5	18/13/0/5
Failure to Conduct Consumer Notice	66						15/14/0/1	14/13/0/1
Treatment Installation	58				0/0/0/0	0/0/0/0		
Public education	65				1/1/0/0	1/1/0/0		
Subtotal					1/1/0/0	1/1/0/0	42/34/0/8	35/28/0/7

CONSUMER NOTIFICATION: CONSUMER CONFIDENCE REPORTS / PUBLIC NOTIFICATION (ACTIVE SYSTEMS)

	SDWIS Codes	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations	Number of Systems with Violations	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
Consumer Confidence Report	71						95/95/0/0	85/85/0/0
Consumer Confidence Report	72						12/12/0/0	11/11/0/0
Public Notification	75						426/240/180/6	153/69/81/3
Subtotal							533/347/180/6	249/165/81/3

T/C/N/P – Total / Community PWS / Transient Non-Community PWS / Non-Transient Non-Community PWS

VIOLATIONS TABLES: RADIONUCLIDES

	SDWIS Codes	MCL (pCi/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations	Number of Systems with Violations	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
Radionuclide MCLs								
Gross alpha	4109	15 pCi/L	0/0/0/0	0/0/0/0			0/0/0/0	0/0/0/0
Combined R228/R226	4010	5 pCi/L	0/0/0/0	0/0/0/0			0/0/0/0	0/0/0/0
Gross beta	4100	4 mrem/yr	0/0/0/0	0/0/0/0			0/0/0/0	0/0/0/0
Radium-226	4020	5 pCi/L	0/0/0/0	0/0/0/0			0/0/0/0	0/0/0/0
Radium-228	4030	5 pCi/L	0/0/0/0	0/0/0/0			0/0/0/0	0/0/0/0
Subtotal			0/0/0/0	0/0/0/0			0/0/0/0	0/0/0/0

T/C/N/P – Total /Community PWS / Transient Non-Community PWS / Non-Transient Non-Community PWS

DEFINITIONS FOR THE VIOLATIONS TABLES

Public Water System: A Public Water System (PWS) is defined as a system that provides water via piping or other constructed conveyances for human consumption to at least 15 service connections or serves an average of at least 25 people for at least 60 days each year. There are three types of PWSs. PWSs can be community (such as towns), non-transient non-community (such as schools or factories), or transient non-community systems (such as rest stops or parks). In this report, when the acronym “PWS”, is used, it means systems of all types unless otherwise specified.

Consumer Notification: Every community water system is required to deliver to its customers a brief annual water quality report (CCR). This report is to include some educational material, and will provide information on the source water, the levels of any detected contaminants.

Public Water System: A Public Water System (PWS) is defined as a system that provides water via piping or other constructed conveyances for human consumption to at least 15 service connections or serves an average of at least 25 people for at least 60 days each year. There are three types of PWSs. PWSs can be community (such as towns), non-transient non-community (such as schools or factories), or transient non-community systems (such as rest stops or parks). In this report, when the acronym “PWS”, is used, it means systems of all types unless otherwise specified.

Consumer Notification: Every community water system is required to deliver to its customers a brief annual water quality report (CCR). This report is to include some educational material, and will provide information on the source water, the levels of any detected contaminants, and compliance with drinking water regulations.

Filtered Systems: Water systems that have installed filtration treatment [40 CFR 141, Subpart H].

Inorganic Contaminants: Non-carbon-based compounds such as metals, nitrates, and asbestos. These contaminants are naturally occurring in some water, but can get into water through farming, chemical manufacturing, and other human activities. EPA has established MCLs for 15 inorganic contaminants [40 CFR 141.62].

Lead and Copper Rule: This rule established national limits on lead and copper in drinking water [40 CFR 141.80-91]. Lead and copper corrosion pose various health risks when ingested at certain levels and can enter drinking water from household pipes and plumbing fixtures. States report violations of the Lead and Copper Rule in the following six categories:

Initial lead and copper tap M/R: SDWIS Violations Code 51 indicates that a system did not meet initial lead and copper testing requirements or failed to report the results of those tests to the State.

Follow-up or routine lead and copper tap M/R: SDWIS Violations code 52 indicates that a system did not meet follow-up or routine lead and copper tap testing requirements or failed to report the results.

Treatment installation: SDWIS Violation Code 58 indicates a failure to install optimal corrosion control treatment system or source water treatment system which would reduce lead and copper levels in water at the tap.

Public Education: SDWIS Violation Code 65 shows that a system did not provide required public education about reducing or avoiding lead intake from water.

Maximum Contaminant Level (MCL): The highest amount of a contaminant that EPA allows in drinking water. MCLs ensure that drinking water does not pose either a short-term or long-term health risk. MCLs are defined in milligrams per liter (parts per million) unless otherwise specified.

Monitoring: EPA specifies which water testing methods the water systems must use and sets schedules for the frequency of testing. A water system that does not follow EPA's schedule or methodology is in violation [40 CFR 141].

States must report monitoring violations that are significant as determined by the EPA Administrator and in consultation with the States. For purposes of this report, significant monitoring violations are major violations and they occur when no samples are collected or no results are reported during a compliance period.

A major monitoring violation for the surface water treatment rule occurs when at least 10% of the required samples are not taken or results are not reported during the compliance period.

Organic Contaminants: Carbon-based compounds, such as industrial solvents and pesticides. These contaminants generally get into water through runoff from cropland or discharge from factories. EPA has set legal limits on 54 organic contaminants that are to be reported [40 CFR 141.61].

Public Notice Violations: The Public Notification Rule requires all PWS to notify their consumers any time a PWS violated a national drinking water regulation or has a situation posing a risk to public health. Notices must be provided to persons served (not just billing consumers).

Radionuclides: Radioactive particles, which can occur naturally in water or result from human activity. EPA has set legal limits on five types of radionuclides: radium-226, radium 228, gross alpha, and beta particle/photon radioactivity, and uranium [40 CFR 141]. Violations for these contaminants are to be reported using the following three categories:

Gross alpha: SDWIS Contaminant Code 4000 for alpha radiation above MCL of 15 pCi/L. Gross alpha includes radium-226 but excludes radon and uranium.

Combined radium-226 and radium-228: SDWIS Contaminant Code 4010 for combined radiation from these two isotopes above MCL of 5 pCi/L.

Gross beta: SDWIS Contaminant Code 4101 for the combination of beta particles and photon radioactivity resulting from man-made radionuclides above 4 millirem/year.

Uranium: SDWIS Contaminant Code 4006 for combined uranium above the MCL of 30 micrograms/liter.

Reporting Interval: The reporting interval for violations reported in the 2025 PWS Annual Compliance Report, is January 1, 2025 through December 31, 2025.

SDWIS Code: Specific numeric codes from the Safe Drinking Water Information System (SDWIS) have been assigned to each violation type included in this report. The violations to be reported include exceeding contaminant MCLs, failure to comply with treatment requirements, and failure to meet monitoring and reporting requirements. Four-digit SDWIS Contaminant Codes have also been included in the chart for specific MCL contaminants.

Surface Water Treatment Rule / Ground Water Rule: The Surface Water Treatment Rule [40 CFR 141, Subpart H] and the Ground Water Rule [40 CFR 141, Subpart S] establishes criteria under which water systems supplied by surface water sources, or ground water sources under the direct influence of surface water, must filter and disinfect their water. Violations under both rules are to be reported for the following four categories:

Monitoring, routine/repeat (for filtered systems): SDWIS Violation Code 36 indicates a system's failure to carry out required tests, or to report the results of those tests.

Treatment techniques (for filtered systems): SDWIS Violations 41, 42, and 43 show a system's failure to properly treat its water.

Monitoring, routine/repeat (for unfiltered systems): SDWIS Violation Code 31 indicates a system's failure to carry out required water tests, or to report the results of those tests.

Failure to filter (for unfiltered systems): SDWIS Violation Code 42 shows a system's failure to properly treat its water.

REVISED TOTAL COLIFORM RULE (RTCR): The Revised Total Coliform Rule adds or changes the requirements for the regulations for microbiological contaminants in drinking water established in the Total Coliform Rule. The RTCR rule establishes 16 new violation codes for four categories. (1.) Maximum Contaminant Level (MCL), (2.) Treatment Technique (TT), (3.) Monitoring (MON), (4.) Reporting (RPT).

RTCR MCL Violation: Violation code 1A is for an *E.coli* MCL.

RTCR Treatment Technique Violations: Violation codes: 2A failure to perform a Level 1 assessment, 2B failure to perform a Level 2 assessment, 2C failure to take corrective action, 2D failure to perform proper start up procedures.

RTCR Monitoring Violations: Violation codes: 3A is a routine monitoring violation, 3B failure to collect additional routine samples required after a positive total coliform sample, 3C failure to collect additional samples triggered by turbidity, 3D lab and/or analytical method errors.

RTCR Reporting Violations: 4A Assessment forms reporting, 4B Sample results reporting, 4C Certification form (for start up procedures), 4D *E.coli* positive notification reporting, 4E *E.coli* MCL reporting, 4F Assessments, Assessment forms, corrective/expedited actions reporting.

RTCR Other: 5A Errors with sample siting plan, 5B RTCR recordkeeping violations.

Treatment Techniques: A water treatment process that EPA requires instead of an MCL for contaminants that laboratories cannot adequately measure. Failure to meet other operational and system requirements under the Surface Water Treatment and the Lead and Copper Rules have also been included in this category of violation for purposes of this report.

Unfiltered Systems: Water systems that do not need to filter their water before disinfecting it because the source is very clean [40 CFR, Subpart H].

Violation: A failure to meet any state or federal drinking water regulation.

VARIANCES AND EXEMPTIONS

Variances and exemptions to specific requirements under the Safe Drinking Water Act Amendments of 1996 may be granted under certain circumstances. If, due to the characteristics of the raw water sources reasonably available, a PWS cannot meet the MCL, a primacy State can grant the PWS a variance from the applicable primary drinking water regulation on the condition that the system, install the best available technology, treatment techniques, or other means which the Administrator finds are available (taking costs into account). The state must find that the variance will not result in an unreasonable risk to health, and shall prescribe, at the time the variance is granted, a schedule (including increments of progress) in accordance with which the PWS must come into compliance with the MCL.

Small systems (serving 3,300 or fewer persons; or 10,000 or fewer persons with the Administrator's approval) may be granted variances if they cannot afford (as determined by application of the Administrator's affordability criteria) to comply with certain MCLs (non-microbial, promulgated after January 1, 1986) by means of treatment, alternative source of water, or restructuring or consolidation. Small systems must, within 3 years, install and operate EPA approved small system variance technology. The variance must ensure adequate protection of human health, and the variance shall be reviewed not less than every 5 years to determine whether the system remains eligible for the variance.

A primacy State may by exemption relieve a PWS of its obligation to comply with an MCL, treatment technique, or both if the system's noncompliance results from compelling factors (which may include economic factors, the system was in operation on the effective date of the MCL or treatment technique requirement) or if not in operation by that date, only if no reasonable alternative source of drinking water is available to such new systems, management or restructuring changes cannot reasonably be made that will result in compliance with the SDWA or improvement of water quality, and the exemption will not result in an unreasonable risk to public health. The State will require the PWS to comply with the MCL or treatment technique as expeditiously as practicable, but not later than 3 years after the otherwise applicable compliance date. No variances or exemptions were issued to any public water system in Arkansas during the calendar year 2025.

ENFORCEMENT DEFINITIONS

The Arkansas Department of Health has developed a multi-stage enforcement escalation scheme which pair's technical assistance with multiple opportunities to return to compliance. The ADH utilizes methods such as sanitary surveys and operator assistance to prevent water quality problems from occurring. Enforcement is with the attitude of protecting the public health with any and all tools available to achieve compliance.

Phase 1: A very informal means of enforcement. With every Safe Drinking Water Act (SDWA) violation, a Notice of violation is issued explaining what the system failed to do, in anticipation of correcting the problem. If necessary, a site visit may be required to assist the water system into achieving compliance.

Phase 2: When an Acute violation or several other violations occur and meet our escalation policy we issue a State Formal Notification of Violation (SFJ). This is our 1st formal enforcement action & last chance for voluntary compliance. This letter formally warns the operator that if an additional violation occurs an Administrative Order will be issued to correct the deficiencies.

Phase 3: If the system has an additional violation within the 12 months following the SFJ, an Administrative Orders Issued (SFL) is issued, requiring the system to correct all deficiencies and comply fully with the SDWA.

Phase 4: If the SFL is not complied with a Proposed Penalties Issued (SFN) is calculated based on the population, severity, correct ability and frequency of the violations. It is then issued to the system and a hearing date is scheduled for a Subcommittee of the Arkansas State Board of Health.

Phase 5: Once the proposed penalty is issued the water system operator can either go to the hearing before the subcommittee of the Board of Health, Penalties Assessed – Board of Health (SFM) or Penalties Suspended – Board of Health (SFO).

SUMMARY OF FORMAL ENFORCEMENT ACTIONS

Following is a summary of the enforcement actions taken in 2025

Community Public Water Systems

State Formal Notification of Violation (SFJ).....	101
Administrative Orders Issued (SFL).....	19
Proposed Penalties Issued (SFN).....	0
Penalties Suspended – Board of Health (SFO).....	0
Penalties Assessed – Bilateral Compliance Agreements (SFK).....	5
Penalties Assessed – Board of Health (SFM).....	12
Total Enforcement Actions for CWSs.....	137

Non-Transient Non-Community Systems

State Formal Notification of Violation (SFJ).....	4
Administrative Orders Issued (SFL).....	0
Proposed Penalties Issued (SFN).....	0
Penalties Suspended – Board of Health (SFO).....	0
Penalties Assessed – Bilateral Compliance Agreements (SFK).....	0
Penalties Assessed – Board of Health (SFM).....	0
Total Enforcement Actions for NTNC.....	4

Transient Non-Community Systems

State Formal Notification of Violation (SFJ).....	42
Administrative Orders Issued (SFL).....	1
Proposed Penalties Issued (SFN).....	0
Penalties Suspended – Board of Health (SFO).....	0
Penalties Assessed – Bilateral Compliance Agreements (SFK).....	0
Penalties Assessed – Board of Health (SFM).....	3
Total Enforcement Actions for Transient NC.....	46

COMPLIANCE ASSISTANCE EFFORTS

Capacity Development Program

Under the Capacity Development Program, the Engineering Branch has established two contracts with third party technical assistance providers for small systems (<10,000 population) technical assistance. The main purpose of the contracts is to help small public water systems develop the ability to achieve and maintain compliance with applicable national primary and secondary drinking water regulations. Helping the water systems attain a state of self-sufficiency is the primary goal.

The Engineering Branch continued its utilization of technical assistance contracts as part of our Capacity Development Program in 2025. Arkansas Rural Water Association was awarded the Technical and Operational contract to assist small public water systems achieve TMF capacity. Communities Unlimited held the Financial and Managerial contract until July 2025, at which point Arkansas Rural Water Association began managing the contract. The goal was to provide more of a “hands on” approach with the Engineering Branch’s staff performing the assessments and the contractor performing system specific types of assistance and training. As part of our efforts, in 2025, Arkansas Rural Water Association assisted in 594 hours of technical assistance in the Technical and Operational contract. Communities Unlimited provided 542.75 hours of technical assistance in the Financial and Managerial contract and Arkansas Rural Water Association provided 123.75 hours of technical assistance in the Financial and Managerial contract for a combined effort of 666.5 total hours of Financial and Managerial assistance to Arkansas systems . Some examples of direct assistance hours provided by the Contractors include regionalization efforts, rate studies, asset management plans, budgets, emergency response plans, on-site peer to peer training, new operator assistance with sampling plans and operations reports, leak detection and repairs, valve maintenance training, and assistance with water treatment problems.

Area Wide Optimization Program

The Arkansas Department of Health has been participating in the EPA Region 6/7 Area Wide Optimization Program (AWOP) with the States of New Mexico, Oklahoma, Louisiana, Texas, Missouri, Kansas and Iowa along with EPA Region 6 staff, EPA Region 7 staff and EPA Technical Support Center Staff. ADH staff members participated in two AWOP quarterly meetings (one remotely and one in-person in Springfield, MO) and in-person for the national meeting in Cincinnati, OH. ADH staff participated with sharing information and program implementation with other states. Turbidity data from monthly operation reports was entered into an Access database for performance tracking and to determine prioritization of efforts.

Sanitary Surveys

Sanitary Surveys conducted by technical staff can consist of reporting deficiencies in the construction or design of a public water system or the operation of the public water system. Sanitary Surveys combined with monitoring and reporting, to complement each other, can be indispensable for assuring the long-term quality and safety of drinking water. In calendar year 2025, there were approximately three hundred seven (307) sanitary surveys performed. Two hundred twenty-three (223) sanitary surveys were performed on the state's community water systems, eighty (80) sanitary surveys were performed on transient non-community water systems, four (4) on non-transient non-community water systems. During the sanitary surveys of community and non-transient non-community water systems, owners are notified of "significant deficiencies". A list of significant deficiencies was developed by ADH staff in compliance with the sanitary survey requirements of the Enhanced Surface Water Treatment Rules and Ground Water Rule. Significant deficiencies are obvious shortcomings that could directly affect water quality and require immediate attention by the owner. Under the ADH protocol developed, owners are notified verbally of the deficiency during the survey and again notified by certified letter following the survey. Surface water systems are given 45 days following the written notification to respond with a plan of action and a timetable to address the significant deficiency. Groundwater systems are given 30 days following written notification to confer with the State and 120 days to be in compliance with an approved corrective action plan.

Industry Education

The Engineering Branch has continued its efforts in educating and informing members of the water industry as well as the general public with its web site and its routine newsletter. From the website, water operators can obtain information about various Branch programs; download copies of state rules, policies, compliance documents and operations reports; determine the result of microbiological analyses, the status of the review of construction plans; and obtain information or guidance about numerous other areas of the drinking water program.

The Branch's newsletter, Arkansas Drinking Water Update, has a distribution list of approximately 3650. A copy is mailed to every water system or licensed water operator as well as all city mayors within the state. Each issue of the newsletter contains information of relevance to the water industry including articles on proposed and final state and federal regulations as well as guidance for implementing the regulations, capacity development, source water protection, water system security, cross connection control, operator training, water licensing, water treatment, area wide optimization, noncompliant systems, fluoridation, and other areas.

Additionally, the Engineering Branch has participated in past years in sponsoring technical tracks at the annual conferences for both the Arkansas Water Works and Water Environment Association (AWW&WEA) and the Arkansas Rural Water Association (ARWA). At the 2022 AWW&WEA and ARWA conferences, the Engineering Branch also sponsored an exhibit hall informational booth.

Source Water Assessment Program (SWAP)

The Engineering Branch has continued its efforts in educating and informing members of the water industry as well as the general public with its web site and its routine newsletter. From the website, water operators can obtain information about various Branch programs; download copies of state rules, policies, compliance documents and operations reports; determine the result of microbiological analyses, the status of the review of construction plans; and obtain information or guidance about numerous other areas of the drinking water program.

The Branch's newsletter, Arkansas Drinking Water Update, has a distribution list of approximately 3650. A copy is mailed to every water system or licensed water operator as well as all city mayors within the state. Each issue of the newsletter contains information of relevance to the water industry including articles on proposed and final state and federal regulations as well as guidance for implementing the regulations, capacity development, source water protection, water system security, cross connection control, operator training, water licensing, water treatment, area wide optimization, noncompliant systems, fluoridation, and other areas.

Additionally, the Engineering Branch has participated in past years in sponsoring technical tracks at the annual conferences for both the Arkansas Water Works and Water Environment Association (AWW&WEA) and the Arkansas Rural Water Association (ARWA). At the 2022 AWW&WEA and ARWA conferences, the Engineering Branch also sponsored an exhibit hall informational booth.

Cross-Connection Control Program

Long term, approximately ninety (90) percent of the community water systems surveyed have at least a partial Cross Connection Control Program (CCCP) and approximately 1/3 of the community water systems have a 100% complete CCCP.

During 2025, staff made four (4) CCCP surveys at water utilities. One visit was made at the AWWA conference to provide two (2) CCCP presentations and training. ADH, also participated/attended the ABPA annual conference hosted in Little Rock. One engineer is active in the American Backflow Prevention Association and the Backflow Prevention Association of Arkansas serving on the board of directors. Three (3) quarterly BPAA seminars were attended, and a program update was presented. Two (2) positions were associated with surveying and providing technical assistance to several water systems pertaining to their CCCP with the help of district engineers and environmental health specialists that provide additional technical assistance and guidance for the water purveyors during routine sanitary surveys throughout the state. ADH continues to remain active with the water system's CCCP surveys by educating and assisting water purveyors with their CCCP.

In addition to providing technical support to district engineering staff, CCCP staff completed five hundred (550) review/comment/approve (RCA) assignments for engineering submittals for commercial fire protection systems in Arkansas.

Comprehensive Performance Evaluations

A CPE is an evaluation of a surface water plant to determine whether the drinking water facility is operating at its optimum capacity and is maintaining compliance with applicable drinking water regulations. The CPE is a systematic procedure that identifies the unique combination of factors, in the areas of design, operation, maintenance and administration that would limit the performance of the water system. The CPE is focused on improving performance of surface water systems by optimizing the use of existing facilities, and, if possible, avoiding construction of new facilities. The ADH has established a goal of conducting two (2) or three (3) CPE's per calendar year. In calendar year 2025, one CPE at North Garland County Regional Water District was conducted. ADH has also focused on targeted technical assistance. In 2025 DBP Technical assistance activities were conducted at El Dorado, Harmony, Tri-County RWDD-Moore's Chapel, Chicot Junction, Southwest Arkansas Water, Danville, and Belleville.

Microbial / Disinfection Byproduct Rules Programs

The Arkansas Department of Health (ADH) has been providing implementation activities for the LT2ESWTR, Stage 2 DBPR, and GWR. Compliance assistance efforts in these areas during the 2025 calendar year include the following:

Long Term 2 Enhanced Surface Water Treatment Rule (LT2ESWTR): As part of the early implementation strategies for large and small systems, the first round of source water monitoring for *Cryptosporidium* and *E. coli* in Arkansas's public water systems began in January 2007. (All Schedule 1 ($\geq 100,000$ people served) systems in Arkansas at that time submitted grandfathered data, so Schedule 2 (99,999 to 50,000 people) monitoring had to commence by April 1, 2007.)

Source water *Cryptosporidium* monitoring data has been and will continue to be used to categorize each source into one of four "Bin" classifications based on the source's average observed pathogen concentration. By the end of calendar year 2025, Round 2 LT2 sampling for one water system has been scheduled for the calendar years of 2016-2027. *Cryptosporidium* analyses continue to be outsourced to a private lab (i.e., Analytical Services, Inc.). Any new small system source water *E. coli* analyses will be completed in-house by the Arkansas Public Health Laboratory.

The turbidity measurements reported on each system's monthly operating report are reviewed in the following month to determine if the minimum allowable treatment performance was achieved. Through the end of 2025, two (2) LT2-specific violations have been levied by Arkansas since treatment monitoring began in 2012.

Surface water systems had to begin a second round of source water monitoring for *Cryptosporidium* and *E. coli* by April 2015. Arkansas initiated this second round early (in July 2014) and split its large systems (serving 10,000 or more people) into two groups. The first group finished all required *Cryptosporidium* and *E. coli* monitoring in 2016, and the second group finished in June 2018. No additional Bin 2 sources were found in Arkansas's large water systems during Round 2 thus far.

Two large surface water systems were built and began operation after Round 1 was completed, and these two completed Round 1 when the others completed Round 2. The source waters for these two systems were classified as Bin 1 sources on September 15, 2016. A second round of *Cryptosporidium* and *E. coli* monitoring had to begin "no later than 6 years following initial bin classification," and theirs began in October 2020 and continued into 2022. All samples have been collected and analyzed with no *Cryptosporidium* oocysts detected in the monthly samples.

Sixty-four (64) small public water systems (serving less than 10,000 people) using 75 source water intakes began Round 2 monitoring for *E. coli* in January 2015. All of these completed *E. coli* sampling by the end of 2017. Seventeen (17) of these small systems with twenty (20) sources triggered *Cryptosporidium* sampling

which began in July 2018. Two other systems also began *Cryptosporidium* monitoring in July 2018, but these two were at the beginning of Round 1. One was a new intake at an existing small system, and the second was a proposed new source for an existing large system. One additional small system began *Cryptosporidium* monitoring in February of 2019 at a proposed new source for a proposed new water treatment plant. Sampling there was completed in 2020.

Of the seventeen (17) small systems with twenty (20) sources that triggered Round 2 *Cryptosporidium* sampling based on their *E. coli* results, all LT2ESWTR sampling has been completed at fifteen (15) systems with seventeen (17) sources. Round 1 sampling was also completed in 2020 for the other three (3) sources cited above (i.e., one new small system intake, one proposed large system intake, and one proposed small system intake). To date, no additional Bin 2 sources have been identified.

Stage 2 Disinfectants and Disinfection Byproducts Rule (DBPR): As part of the continued implementation strategies, TTHM and HAA5 monitoring plans were updated and approved as needed for all community and non-transient non-community water systems. During calendar year 2025, two (2) water systems with results exceeding 80 ppb for TTHM and/or 60 ppb HAA5 was placed on increased monitoring. To gather more representative DBP data or replace sample sites, thirty-four (34) new Stage 2 TTHM/HAA5 monitoring locations were also established by, or with assistance from, Engineering staff.

All Capital Improvement extensions granted under Stage 2 have expired, and all systems are being monitored for compliance. Arkansas continued using the DBP and treatment technique calculation reports and monitoring plans format and continued the operational evaluation level (OEL) report State review policy and tools. In calendar year 2025, a total of sixty-six (96) OEL exceedance notifications were issued, and forty-five (80) OEL reports were received.

Ground Water Rule (GWR):

During the 2025 calendar year, nineteen (19) ground water systems conducted Compliance Monitoring (i.e., monitoring to determine compliance with 4-log virus treatment). Grading for monitoring and reporting requirements was conducted on a monthly basis for each of these system's sources. Seventeen (17) reporting violations were issued under the GWR. Six (6) violations were issued for failure to maintain CT or for failure to conduct compliance monitoring. Five (5) violations were issued for failure to collect source water sampling following a Total Coliform Positive routine sample. RTCR sampling data was reviewed daily for five hundred forty-seven (547) ground water systems with a total of one thousand and twenty-nine (1029) ground water well sources during the 2025 calendar year. From this subset of systems approximately one hundred and twenty-one (121) routine distribution system samples tested total coliform positive and triggered source water monitoring was necessary. No system source tested *E. coli* positive and required additional raw water *E. coli* monitoring. No system had confirmed *E. coli* positive samples as a result of the additional monitoring. Two (2) violations were issued for failure to meet State-designated interim measures. A total of one hundred twenty-seven (127) groundwater consecutive systems were tracked monthly to ensure that their special GWR compliance criteria was met.

Technical Assistance & Training

- Technical assistance and training provided by the Engineering staff occurs in many different areas and in many different forms. Among the more common areas in which technical assistance and training are generally provided are the following:

- Comprehensive Performance Evaluations and follow-ups.
- Comprehensive Technical Assistance
- Jar tests and jar test calibrations
- Disinfection profiles
- Chlorine control studies
- Filter studies & filter backwash procedure studies
- Process control sampling and evaluations
- Field testing of total trihalomethanes
- Bench scale testing of treatment plant modifications
- Distribution system evaluations and modeling to lessen water age and improve water quality.
- Storage tank evaluations and modeling to lessen water age and improve water quality.
- Tracer studies
- Collection of special samples for inorganic and organic analyses
- Evaluation, testing and recommendations on treatment modifications to improve water quality in areas such as disinfection by-products reduction, coagulants, filters, filter backwash, total organic carbon removal, color removal, disinfectants, oxidants, and iron and manganese removal.
- Evaluation, testing, and recommendations on the employment of alternate water sources due to drought conditions.
- Evaluation, testing and recommendations on the development of new sources of water.
- Training of water operators in basic system operation, and onsite water quality monitoring including turbidity, pH, chlorine and chlorine dioxide.
- Input and recommendations on long range and master planning
- Cross connection control program implementation, surveys and incident investigations.
- Following up on citizen inquiries regarding drinking water quality.

The Arkansas Department of Health has been participating in the EPA Region 6/7 Area Wide Optimization Program (AWOP) with the States of New Mexico, Oklahoma, Louisiana, Texas, Missouri, Kansas and Iowa along with EPA Region 6 staff, EPA Region 7 staff and EPA Technical Support Center Staff. ADH staff members participated in two AWOP quarterly meetings (one remotely and one in-person in Springfield, MO) and in-person for the national meeting in Cincinnati, OH. ADH staff participated with sharing information and program implementation with other states. Turbidity data from monthly operation reports was entered into an Access database for performance tracking and to determine prioritization of efforts.

Water Operator Licensing and Training


The purpose of licensing and training water operators is to ensure that all public water systems in the State of Arkansas are maintained by personnel who have shown their competence and knowledge of the public health and scientific principles necessary to produce and deliver adequate quantities of water which meets or exceeds the National Primary and Secondary Drinking Water Standards.

In order to sit for a water operator license exam, specific curriculum-based courses must be attended. The 9 courses range from 8 to 24 hours in length with total hours ranging from 40 hours required for the lowest license grades and 96 hours for the highest license grades. The approved course providers for the treatment, distribution, and math courses are the Arkansas Environmental Training Academy (AETA) and the Arkansas Rural Water Association (ARWA). AETA provided fifty-four (54) classroom courses in calendar year 2025. In addition, AETA conducted twenty-three (23) internet based mandatory training courses in calendar year 2025. ARWA provided twenty-three (23) courses in calendar year 2025. The Engineering Section is the only approved provider of the required public water system regulations and Safe Drinking Water Act compliance course. The Compliance course was provided seventeen (17) times in calendar year 2025. A total of one hundred seventeen (117) training sessions were offered by the three approved training organizations in calendar year 2025. AETA utilized distance education technology adopting a hybrid model of in-person attendance at the training center combined with live virtual attendance for many of their mandatory courses. Both trainers primarily used their training centers during the year with the Engineering Section providing the Compliance Course in those same locations.


A large number of approved general and specialized training courses are provided to assist licensed operators in meeting their continuing education requirements for license renewal. The courses are offered through conferences, general meetings, and workshops. They are provided by the Arkansas Water Works and Water Environment Association and its local training districts, the Arkansas Rural Water Association; the Arkansas Environmental Training Academy; the Arkansas Water and Wastewater Managers Association and the Arkansas Department of Health. Various other industry groups and private vendors offer a large array of other relevant training, both site-based and internet based to water operators. Distance learning concepts/technologies have become a significant contributor to the available continuing education for license renewal.

In calendar year 2025, approximately eight hundred sixty-seven (867) water operator license exams were administered, three hundred and six (306) water operator licenses were issued, and sixty-eight (68) Operator-In-Training (OIT) certificates were issued. An OIT is issued to operators who do not meet the experience requirement at the time their license exam was passed. Upon completion of their experience requirement the license is issued. The water licensing program had two thousand four hundred forty-three (2443) active licensed water operators or OIT certificates at the end of calendar year 2025. They held three thousand two hundred eleven (3211) treatment, distribution, and/or very small system licenses or OIT certificates.

Violations By Type Of System Graph

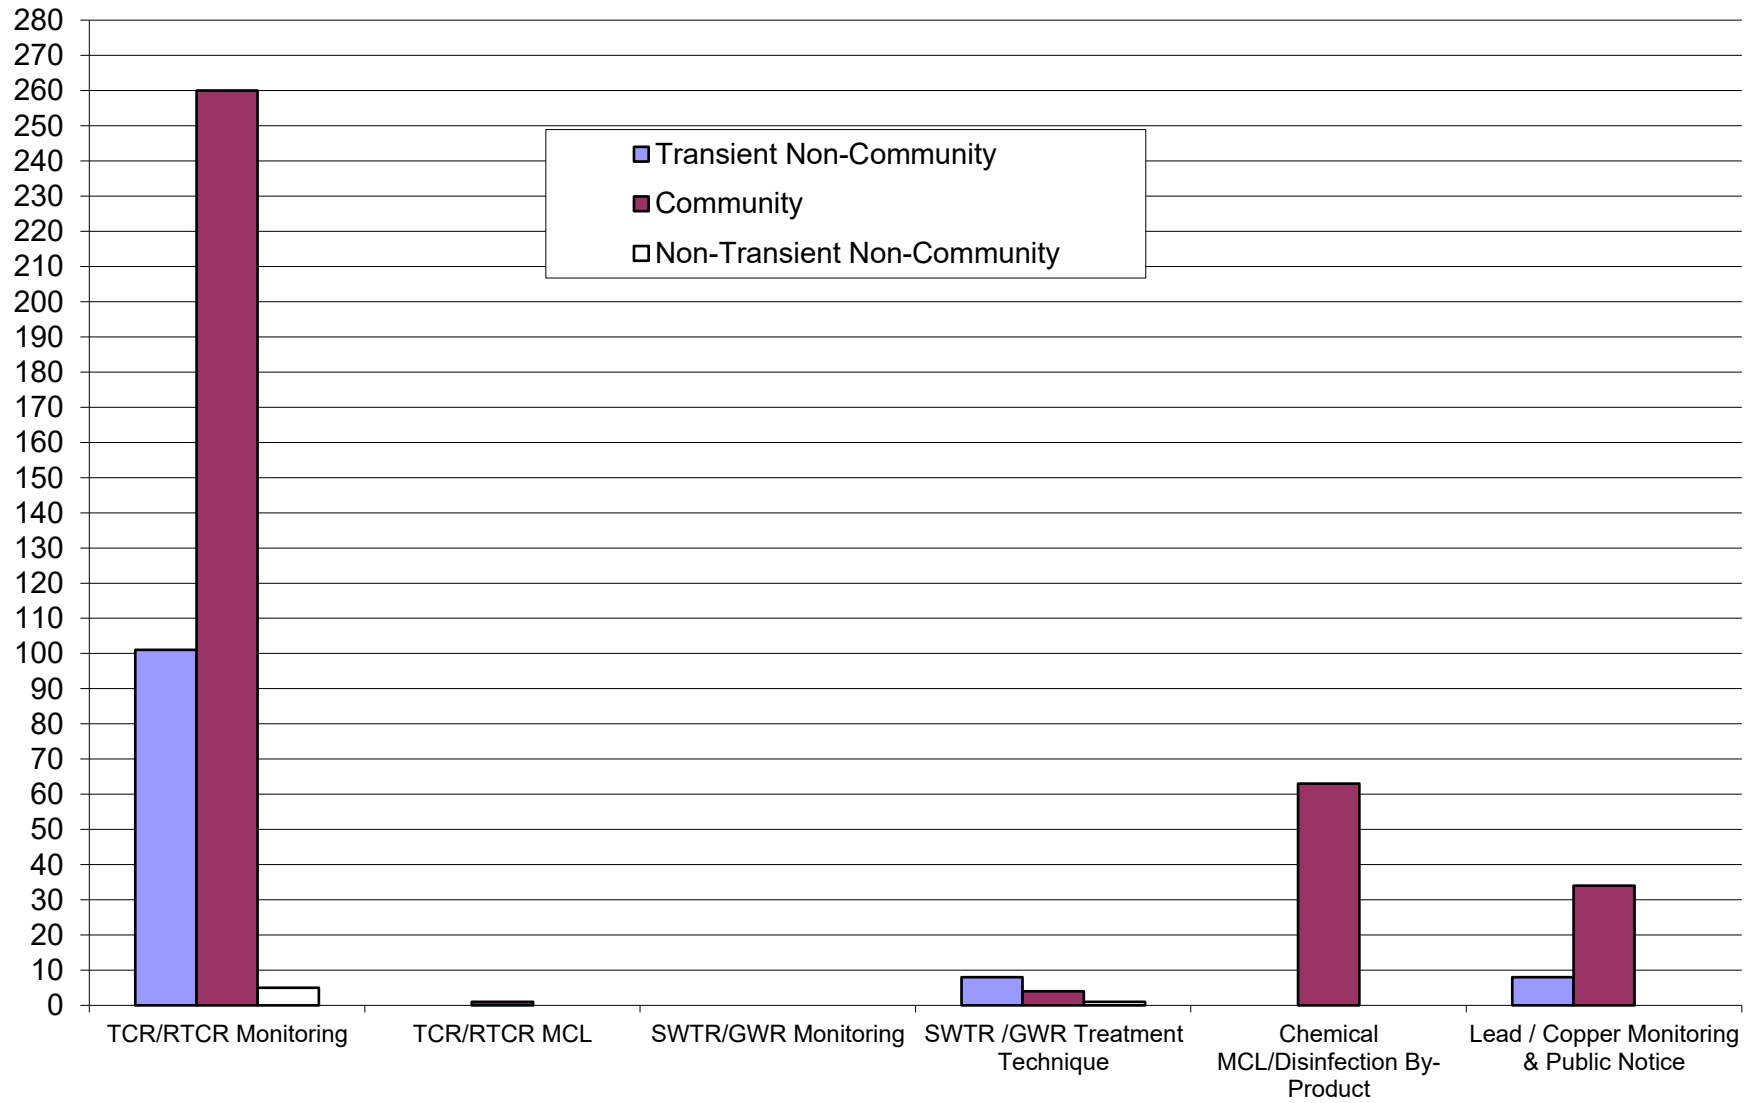

Enforcement Actions By Type Of System Graph

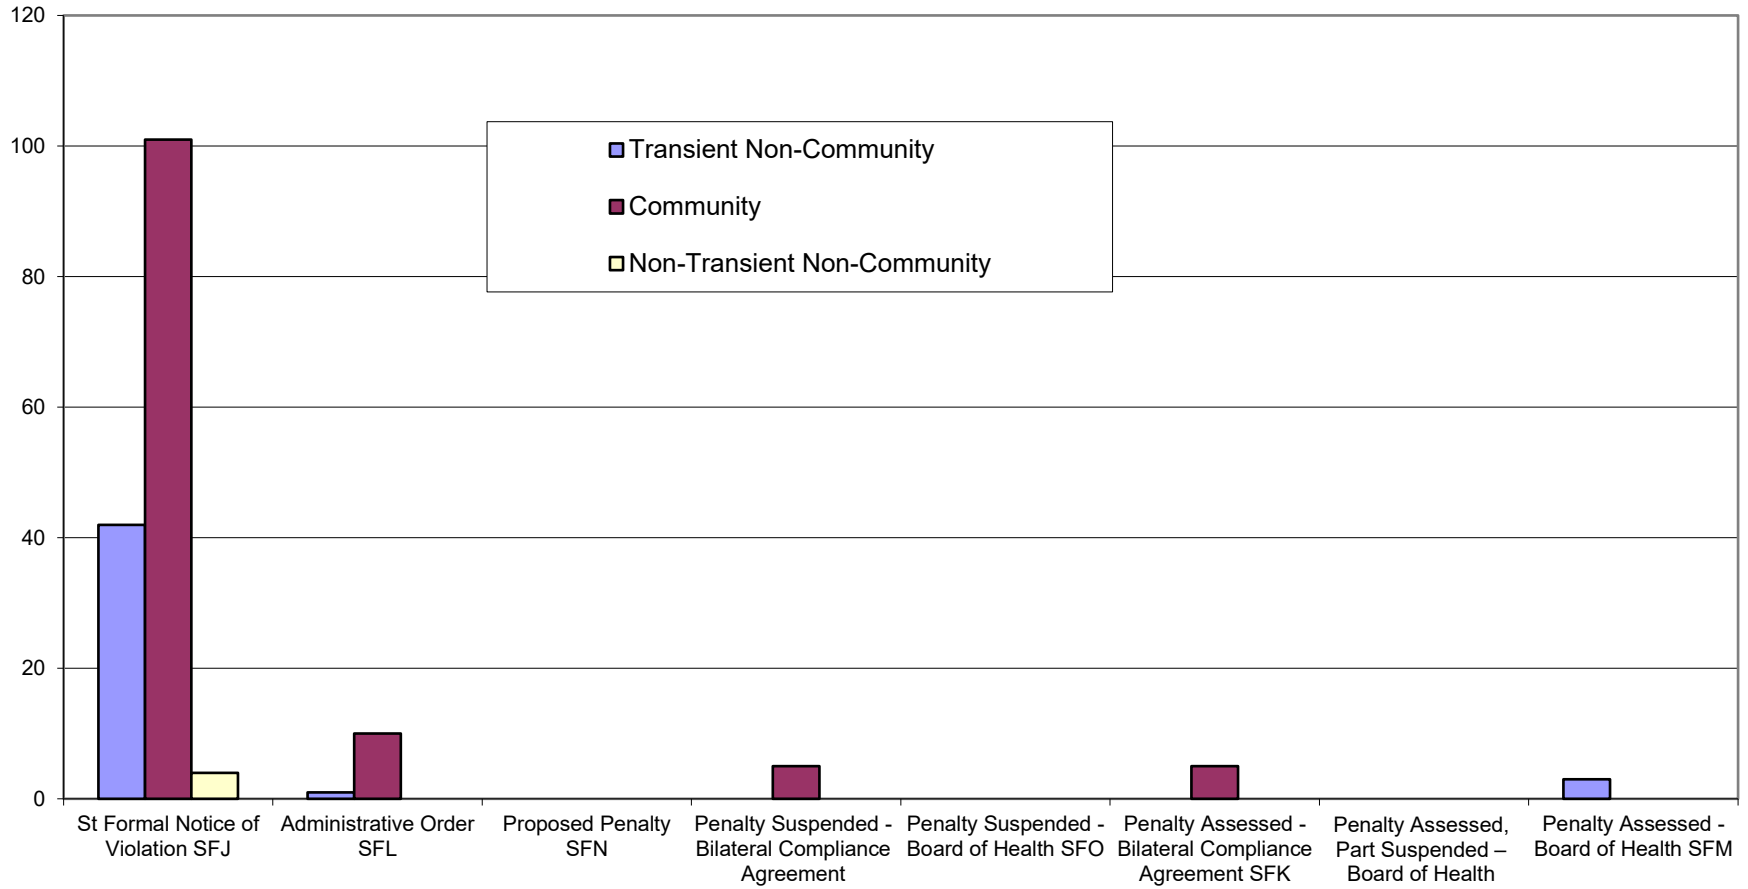

APPENDICES

Appendix A - Microbiological Maximum Contaminant Level Violations

PWS type: C

PWS	System Name	SDWIS Code	Violation Date	Retail population
173	REED WATERWORKS	1A	4/1/2025	209

Appendix B -Microbiological Monitoring - No Valid Samples

PWS type: C

PWS	System Name	SDWIS Code	Violation Date	Retail population
006	ALMYRA WATERWORKS	3A	4/1/2025	349
346	AUSTIN WATERWORKS	3A	7/1/2025	3600
890	AUTUMN ACRES MHP	3A	8/1/2025	68
890	AUTUMN ACRES MHP	3A	9/1/2025	68
890	AUTUMN ACRES MHP	3A	10/1/2025	68
890	AUTUMN ACRES MHP	3A	11/1/2025	68
890	AUTUMN ACRES MHP	3A	12/1/2025	68
689	BALD KNOB NORTH WATER ASSOC	3A	12/1/2025	2624
497	BAUXITE WATER	3A	1/1/2025	705
497	BAUXITE WATER	3A	2/1/2025	705
401	BEARDEN WATERWORKS	3A	8/1/2025	2511
123	BLACK OAK WATERWORKS	3A	8/1/2025	245
799	BLUEBIRD WATER, LLC	3A	9/1/2025	205
887	BODCAW RURAL WATER SYSTEM	3A	1/1/2025	1430
887	BODCAW RURAL WATER SYSTEM	3A	2/1/2025	1430
178	BOIS D'ARC WATER SYSTEM	3A	1/1/2025	53
178	BOIS D'ARC WATER SYSTEM	3A	2/1/2025	53
178	BOIS D'ARC WATER SYSTEM	3A	4/1/2025	53
178	BOIS D'ARC WATER SYSTEM	3A	5/1/2025	53
178	BOIS D'ARC WATER SYSTEM	3A	6/1/2025	53
178	BOIS D'ARC WATER SYSTEM	3A	7/1/2025	53
587	BRADFORD WATERWORKS	3A	11/1/2025	986
054	BRADLEY CO RURAL WATER ASSN	3A	7/1/2025	1163
223	BRECKENRIDGE UNION WATER ASSOC	3A	10/1/2025	1225
024	BRIARCLIFF WATERWORKS	3A	9/1/2025	338
024	BRIARCLIFF WATERWORKS	3A	11/1/2025	338
737	BUENA VISTA-OGEMAW WATER	3A	12/1/2025	445
044	CENTERTON WATERWORKS	3A	1/1/2025	27243
101	COMMUNITY WATER SYSTEM	3A	1/1/2025	18628
119	CONWAY CO REGIONAL WATER DIST	3A	1/1/2025	22505
596	COTTON PLANT WATERWORKS	3A	5/1/2025	435
596	COTTON PLANT WATERWORKS	3A	6/1/2025	435
596	COTTON PLANT WATERWORKS	3A	9/1/2025	435
596	COTTON PLANT WATERWORKS	3A	12/1/2025	435
670	DEER WATER ASSOCIATION	3A	6/1/2025	938
670	DEER WATER ASSOCIATION	3A	9/1/2025	938

Thursday, May 14, 2026

Appendix B

Appendix B -Microbiological Monitoring - No Valid Samples

083	EUDORA WATERWORKS	3A	11/1/2025	2600
358	FOUKE WATERWORKS	3A	1/1/2025	955
358	FOUKE WATERWORKS	3A	2/1/2025	955
358	FOUKE WATERWORKS	3A	12/1/2025	955
016	FOUNTAIN HILL WATERWORKS	3A	2/1/2025	1028
154	GILMORE WATERWORKS	3A	11/1/2025	248
734	GRAND PRAIRIE BAYOU 2 PWA	3A	5/1/2025	13519
696	GREASY VALLEY WPFB LOGAN CO.	3A	12/1/2025	700
884	HOSANNA HEIGHTS WATER	3A	2/1/2025	52
884	HOSANNA HEIGHTS WATER	3A	6/1/2025	52
884	HOSANNA HEIGHTS WATER	3A	8/1/2025	52
010	HUMPHREY WATERWORKS	3A	10/1/2025	602
749	HWY 64 WATER ASSOCIATION	3A	1/1/2025	215
749	HWY 64 WATER ASSOCIATION	3A	4/1/2025	215
749	HWY 64 WATER ASSOCIATION	3A	8/1/2025	215
749	HWY 64 WATER ASSOCIATION	3A	11/1/2025	215
263	JACKSONPORT WATERWORKS	3A	11/1/2025	233
168	KELSO-ROHWER WATER ASSOCIATION	3A	8/1/2025	563
108	KINGSLAND WATERWORKS	3A	11/1/2025	447
420	LAKE VIEW MUNICIPAL WATER	3A	1/1/2025	665
420	LAKE VIEW MUNICIPAL WATER	3A	8/1/2025	665
420	LAKE VIEW MUNICIPAL WATER	3A	11/1/2025	665
726	LAKESHORE ESTATES WATER ASSN	3A	1/1/2025	568
726	LAKESHORE ESTATES WATER ASSN	3A	11/1/2025	568
747	LEISURE HILLS MOBILE HOME PARK	3A	7/1/2025	113
747	LEISURE HILLS MOBILE HOME PARK	3A	10/1/2025	113
500	LESLIE WATER SYSTEM	3A	9/1/2025	730
430	MARKED TREE WATERWORKS	3A	11/1/2025	2566
430	MARKED TREE WATERWORKS	3A	12/1/2025	2566
637	MARVELL RURAL WATER ASSOC	3A	8/1/2025	1305
421	MARVELL WATERWORKS	3A	8/1/2025	1035
042	MOCKINGBIRD HILL WATER ASSOC	3A	5/1/2025	875
042	MOCKINGBIRD HILL WATER ASSOC	3A	8/1/2025	875
176	MOUNTAIN PINE WATERWORKS	3A	9/1/2025	805
680	MT SHERMAN WATER ASSOCIATION	3A	3/1/2025	903
680	MT SHERMAN WATER ASSOCIATION	3A	4/1/2025	903
425	MURFREESBORO WATERWORKS	3A	7/1/2025	1645
856	NAIL SWAIN WATER ASSOCIATION	3A	11/1/2025	970
022	NORTH CROSSETT UTILITIES	3A	11/1/2025	3222

Thursday, May 14, 2026

Appendix B

Appendix B -Microbiological Monitoring - No Valid Samples

1075	NORTH HOWARD RURAL WATER	3A	12/1/2025	710
826	NORTH PIKE CO RURAL WATER ASSN	3A	1/1/2025	1976
146	OAK GROVE WATER ASSOCIATION	3A	6/1/2025	2963
089	OKOLONA WATERWORKS	3A	11/1/2025	562
530	OZARK ACRES WATER ASSOCIATION	3A	5/1/2025	830
736	PARTHENON WATER ASSOCIATION	3A	2/1/2025	408
649	PENDLETON-PEA RIDGE WATER ASSN	3A	8/1/2025	845
172	PICKENS WATERWORKS	3A	2/1/2025	49
172	PICKENS WATERWORKS	3A	3/1/2025	49
172	PICKENS WATERWORKS	3A	5/1/2025	49
172	PICKENS WATERWORKS	3A	8/1/2025	49
172	PICKENS WATERWORKS	3A	10/1/2025	49
172	PICKENS WATERWORKS	3A	12/1/2025	49
818	PIKE CITY WATER ASSN	3A	2/1/2025	333
477	RAVENDEN SPRINGS WATERWORKS	3A	11/1/2025	139
477	RAVENDEN SPRINGS WATERWORKS	3A	12/1/2025	139
173	REED WATERWORKS	3A	11/1/2025	209
106	RISON WATERWORKS	3A	12/1/2025	1344
492	SALEM WATER USERS LLC	3A	4/1/2025	22775
492	SALEM WATER USERS LLC	3A	10/1/2025	22775
492	SALEM WATER USERS LLC	3A	11/1/2025	22775
492	SALEM WATER USERS LLC	3A	12/1/2025	22775
005	ST CHARLES WATERWORKS	3A	11/1/2025	326
005	ST CHARLES WATERWORKS	3A	12/1/2025	326
296	STAMPS WATERWORKS	3A	3/1/2025	1633
556	STRONG WATERWORKS	3A	11/1/2025	1131
882	SYLAMORE VALLEY WATER ASSN	3A	7/1/2025	290
155	TURRELL WATER WORKS	3A	6/1/2025	540
309	WALNUT RIDGE WATERWORKS	3A	7/1/2025	5823
682	WEST SALINE WATER USERS ASSN	3A	11/1/2025	1825
735	WEST STONE COUNTY WATER ASSN	3A	5/1/2025	5188
529	WILLIFORD WATERWORKS	3A	11/1/2025	80
021	WILMOT WATERWORKS	3A	5/1/2025	416
642	WINTHROP WATER ASSOCIATION	3A	9/1/2025	338

PWS type: N

PWS	System Name	SDWIS Code	Violation Date	Retail population
T1066	24 HOUR FUEL 1013	3A	9/1/2025	30
T1066	24 HOUR FUEL 1013	3A	10/1/2025	30

Thursday, May 14, 2026

Appendix B

Appendix B -Microbiological Monitoring - No Valid Samples

T1066	24 HOUR FUEL 1013	3A	11/1/2025	30
T1066	24 HOUR FUEL 1013	3A	12/1/2025	30
T1105	3B OFF ROAD, LLC	3A	11/1/2025	25
1177	ANCHOR'S LANDING AT WOODS POINT	3A	7/1/2025	72
1177	ANCHOR'S LANDING AT WOODS POINT	3A	8/1/2025	72
T0171	ANGLERS LAKE AND STEAK	3A	8/1/2025	50
T0171	ANGLERS LAKE AND STEAK	3A	10/1/2025	50
T0171	ANGLERS LAKE AND STEAK	3A	11/1/2025	50
T1086	BEAR CREEK COUNTRY STORE	3A	9/1/2025	50
T1086	BEAR CREEK COUNTRY STORE	3A	10/1/2025	50
T1086	BEAR CREEK COUNTRY STORE	3A	11/1/2025	50
T1086	BEAR CREEK COUNTRY STORE	3A	12/1/2025	50
T0486	BEAVER LAKE GLAMPING & RV RESORT	3A	4/1/2025	25
T0486	BEAVER LAKE GLAMPING & RV RESORT	3A	6/1/2025	25
T0486	BEAVER LAKE GLAMPING & RV RESORT	3A	8/1/2025	25
T0751	BEAVER RV PARK	3A	4/1/2025	100
1155	BLUE BELL CAFE	3A	5/1/2025	25
1155	BLUE BELL CAFE	3A	6/1/2025	25
1155	BLUE BELL CAFE	3A	8/1/2025	25
1155	BLUE BELL CAFE	3A	9/1/2025	25
1155	BLUE BELL CAFE	3A	10/1/2025	25
T0091	BROOKHILL RANCH	3A	7/1/2025	250
T1080	CITGO FOOD MART	3A	4/1/2025	250
T1080	CITGO FOOD MART	3A	5/1/2025	250
T1080	CITGO FOOD MART	3A	8/1/2025	250
T1080	CITGO FOOD MART	3A	9/1/2025	250
T1103	CLOUD 9 RV PARK	3A	12/1/2025	25
T0163	COUNTRY MOUNTAIN INN	3A	9/1/2025	100
T0563	Cowboy Ranch RV Park	3A	3/1/2025	25
T0563	Cowboy Ranch RV Park	3A	4/1/2025	25
T0563	Cowboy Ranch RV Park	3A	5/1/2025	25
T0563	Cowboy Ranch RV Park	3A	8/1/2025	25
T0563	Cowboy Ranch RV Park	3A	12/1/2025	25
1255	EASY K RANCH	3A	1/1/2025	25
1255	EASY K RANCH	3A	2/1/2025	25
1255	EASY K RANCH	3A	5/1/2025	25
1255	EASY K RANCH	3A	8/1/2025	25
1255	EASY K RANCH	3A	10/1/2025	25
1255	EASY K RANCH	3A	11/1/2025	25

Thursday, May 14, 2026

Appendix B

Appendix B - Microbiological Monitoring - No Valid Samples

T0269	FERNDALE MARKET	3A	2/1/2025	25
T0269	FERNDALE MARKET	3A	5/1/2025	25
T0269	FERNDALE MARKET	3A	11/1/2025	25
T0269	FERNDALE MARKET	3A	12/1/2025	25
T0932	GASKINS CABIN STEAKHOUSE	3A	1/1/2025	75
1253	HILLBILLY SLIMS	3A	5/1/2025	25
1253	HILLBILLY SLIMS	3A	7/1/2025	25
945	HOT SPRINGS OFF-ROAD PARK	3A	5/1/2025	80
1094	JENNINGS ENTERPRISES	3A	8/1/2025	50
T0297	KETTLE CAMPGROUND	3A	5/1/2025	55
T0297	KETTLE CAMPGROUND	3A	8/1/2025	55
T0297	KETTLE CAMPGROUND	3A	11/1/2025	55
T0381	KWIK SERV	3A	10/1/2025	500
T0330	LITTLE FIR LANDING	3A	8/1/2025	250
1296	Little River RV Park	3A	8/1/2025	25
T1090	LOST BRIDGE MARINA	3A	6/1/2025	25
T1090	LOST BRIDGE MARINA	3A	8/1/2025	25
T0373	MOOSE LODGE 1953	3A	5/1/2025	25
T1068	NORFORK LAKE ESTATES-MOHR ADD	3A	4/1/2025	25
T1068	NORFORK LAKE ESTATES-MOHR ADD	3A	9/1/2025	25
T1068	NORFORK LAKE ESTATES-MOHR ADD	3A	10/1/2025	25
T1068	NORFORK LAKE ESTATES-MOHR ADD	3A	12/1/2025	25
957	NORFORK MARINA	3A	7/1/2025	25
957	NORFORK MARINA	3A	8/1/2025	25
957	NORFORK MARINA	3A	9/1/2025	25
1280	NWS INC. HS596 WEST HELENA	3A	1/1/2025	
1292	Opera in the Ozarks	3A	4/1/2025	50
T1016	OZARKS RV RESORT OWNERS	3A	9/1/2025	500
910	R&R COUNTRY STORE	3A	9/1/2025	25
1259	Retreat at Sky Ridge	3A	12/1/2025	50
T0470	ROADRUNNER INN	3A	11/1/2025	25
T0472	ROCKING CHAIR RANCH	3A	5/1/2025	25
T0931	T & A SALOON & IRON HORSE STABLES	3A	4/1/2025	25
T0931	T & A SALOON & IRON HORSE STABLES	3A	5/1/2025	25
T0829	THE INN AT LOST BRIDGE	3A	6/1/2025	25
T0322	THE LANGLEY STORE	3A	6/1/2025	25
T0399	THE OUTPOST	3A	1/1/2025	50
T0399	THE OUTPOST	3A	2/1/2025	50
T0399	THE OUTPOST	3A	3/1/2025	50

Thursday, May 14, 2026

Appendix B

Appendix B -Microbiological Monitoring - No Valid Samples

T0399	THE OUTPOST	3A	4/1/2025	50
T0399	THE OUTPOST	3A	5/1/2025	50
T0399	THE OUTPOST	3A	6/1/2025	50
T0399	THE OUTPOST	3A	7/1/2025	50
T0399	THE OUTPOST	3A	8/1/2025	50
T0399	THE OUTPOST	3A	9/1/2025	50
T0399	THE OUTPOST	3A	10/1/2025	50
T0399	THE OUTPOST	3A	11/1/2025	50
855	TWIN OAKS MOBILE HOME PARK	3A	11/1/2025	10
T0692	USCOE NFWP18 HENDERSON	3A	6/1/2025	80
T0835	WANDERLUST RV PARK	3A	11/1/2025	25

PWS type: P

PWS	System Name	SDWIS Code	Violation Date	Retail population
1243	HAPPY FEET LEARNING CENTER	3A	7/1/2025	42
731	RIVER BEND PARK POA	3A	11/1/2025	1920

PWS type: V

PWS	System Name	SDWIS Code	Violation Date	Retail population
N0186	CULLIGAN WATER CONDITIONING	3A	4/1/2025	30
972	GENERAL WATER CONDITIONING	3A	1/1/2025	30
972	GENERAL WATER CONDITIONING	3A	3/1/2025	30
972	GENERAL WATER CONDITIONING	3A	4/1/2025	30
972	GENERAL WATER CONDITIONING	3A	7/1/2025	30
972	GENERAL WATER CONDITIONING	3A	8/1/2025	30
972	GENERAL WATER CONDITIONING	3A	9/1/2025	30
972	GENERAL WATER CONDITIONING	3A	11/1/2025	30
1252	NATURAL PURE 1 HOLIDAY ISLAND	3A	12/1/2025	30
T1106	WATER WAGON	3A	11/1/2025	25

Thursday, May 14, 2026

Appendix B

Appendix C - Microbiological Monitoring - Failure Address Level 1 or Level 2 Assessment

PWS type: C

PWS	System Name	SDWIS Code	Violation Date	Retail population
649	PENDLETON-PEA RIDGE WATER ASSN	2A	2/1/2025	845
649	PENDLETON-PEA RIDGE WATER ASSN	2A	3/1/2025	845

PWS type: N

PWS	System Name	SDWIS Code	Violation Date	Retail population
T0399	THE OUTPOST	2A	6/1/2024	50

Appendix E - Treatment Technique Violations: Surface Water Treatment Rule, Ground Water Rule and Long Term 2 (LT2)

PWS type: C

PWS	System Name	SDWIS Code	Violation Date	Retail population
603	DANVILLE WATERWORKS	41	1/31/2025	2810
603	DANVILLE WATERWORKS	41	12/31/2025	2810

Appendix F - Chemical Maximum Contaminant Level Violation

PWS type: C

PWS ID	System Name	SDWIS Code	Violation Definition	Violation Date	Retail population
913	BENTON COUNTY WATER AUTHORITY5	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	1813
653	BRANCH WATER WORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2025	500
660	CASA WATER DEPT	2950	Maximum Contaminant Level Violation for TTHM	1/1/2025	1500
660	CASA WATER DEPT	2950	Maximum Contaminant Level Violation for TTHM	1/1/2025	1500
660	CASA WATER DEPT	2950	Maximum Contaminant Level Violation for TTHM	4/1/2025	1500
660	CASA WATER DEPT	2950	Maximum Contaminant Level Violation for TTHM	4/1/2025	1500
660	CASA WATER DEPT	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	1500
660	CASA WATER DEPT	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	1500
660	CASA WATER DEPT	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	1500
661	CHICOT JUNCTION WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	1/1/2025	616
661	CHICOT JUNCTION WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	4/1/2025	616
661	CHICOT JUNCTION WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	616
446	CITY CORPORATION	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	29260
119	CONWAY CO REGIONAL WATER DIST	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	22505

Thursday, May 14, 2026

Appendix F

Appendix F - Chemical Maximum Contaminant Level Violation

603	DANVILLE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2025	2810
603	DANVILLE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2025	2810
603	DANVILLE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	2810
143	DYER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	1028
772	EAST JOHNSON CO WATER ASSN	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2025	5200
550	EL DORADO WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	17932
550	EL DORADO WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	17932
402	HARMONY GROVE WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	2192
402	HARMONY GROVE WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	2192
546	HARMONY WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	1/1/2025	336
546	HARMONY WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	1/1/2025	336
546	HARMONY WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	4/1/2025	336
546	HARMONY WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	4/1/2025	336
546	HARMONY WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	336
546	HARMONY WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	336

Thursday, May 14, 2026

Appendix F

Appendix F - Chemical Maximum Contaminant Level Violation

546	HARMONY WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	336
765	HWY 4 24 WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	4/1/2025	2135
951	MONTGOMERY CO REGIONAL PWA	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	0
951	MONTGOMERY CO REGIONAL PWA	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	7/1/2025	0
951	MONTGOMERY CO REGIONAL PWA	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	0
951	MONTGOMERY CO REGIONAL PWA	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2025	0
951	MONTGOMERY CO REGIONAL PWA	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	0
392	MOUNT IDA WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	7/1/2025	3218
392	MOUNT IDA WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	3218
392	MOUNT IDA WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	3218
392	MOUNT IDA WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2025	3218
136	MULBERRY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2025	1648
136	MULBERRY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2025	1648
697	NE YELL COUNTY WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	7198
616	ODEN- PENCIL BLUFF WATER ASSN.	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	393

Thursday, May 14, 2026

Appendix F

Appendix F - Chemical Maximum Contaminant Level Violation

616	ODEN- PENCIL BLUFF WATER ASSN.	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	393
604	OLA WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2025	1204
604	OLA WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	1204
604	OLA WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	1204
328	PARIS WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	4935
328	PARIS WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2025	4935
329	RATCLIFF WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	4/1/2025	1019
329	RATCLIFF WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	7/1/2025	1019
329	RATCLIFF WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2025	1019
889	SOUTHWEST ARKANSAS WATER SYST	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	1/1/2025	2335
889	SOUTHWEST ARKANSAS WATER SYST	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	4/1/2025	2335
334	SUBIACO ACADEMY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	250
334	SUBIACO ACADEMY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	250
334	SUBIACO ACADEMY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	250
135	SUBIACO CITY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2025	548

Thursday, May 14, 2026

Appendix F

Appendix F - Chemical Maximum Contaminant Level Violation

135	SUBIACO CITY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	548
846	TRI COUNTY RWDD - MOORES CHAPEL	2950	Maximum Contaminant Level Violation for TTHM	1/1/2025	3112
846	TRI COUNTY RWDD - MOORES CHAPEL	2950	Maximum Contaminant Level Violation for TTHM	4/1/2025	3112
846	TRI COUNTY RWDD - MOORES CHAPEL	2950	Maximum Contaminant Level Violation for TTHM	10/1/2025	3112

Appendix G - Radium Maximum Contaminant Level Violation

PWS type:

PWS	System Name	SDWIS Code	Violation Date	Retail population
------------	--------------------	-------------------	-----------------------	--------------------------

NONE

Appendix H - Lead & Copper Rule Monitoring & Treatment Technique Violations

PWS type: C

PWS ID	System Name	SDWIS Code	Violation Definition	Violation Date	RTC date	Retail
197	ALTUS WATERWORKS	66	LEAD CONSUMER NOTICE (LCR)	8/1/2021		1820
622	BATTS-LAPILE WATER ASSOCIATION	66	LEAD CONSUMER NOTICE (LCR)	12/1/2021		583
178	BOIS D ARC WATER SYSTEM	66	LEAD CONSUMER NOTICE (LCR)	1/1/2022		53
178	BOIS D ARC WATER SYSTEM	66	LEAD CONSUMER NOTICE (LCR)	11/1/2024		53
596	COTTON PLANT WATERWORKS	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	10/1/2011		435
596	COTTON PLANT WATERWORKS	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	7/1/2024		435
596	COTTON PLANT WATERWORKS	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	7/1/2025		435
685	DEER RUN WATER COMPANY	66	LEAD CONSUMER NOTICE (LCR)	5/18/2011		119
083	EUDORA WATERWORKS	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	7/1/2025		2600
617	HORSEHEAD WATER ASSOCIATION	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	7/1/2025		5792
884	HOSANNA HEIGHTS WATER	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	7/1/2025		52
749	HWY 64 WATER ASSOCIATION	66	LEAD CONSUMER NOTICE (LCR)	11/1/2024		215
377	JOINER RURAL WATER	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	10/1/2011		343

Appendix H - Lead & Copper Rule Monitoring & Treatment Technique Violations

377	JOINER RURAL WATER	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	7/1/2024		343
377	JOINER RURAL WATER	65	PUBLIC EDUCATION (LCR)	6/1/2025	9/30/2025	343
420	LAKE VIEW MUNICIPAL WATER	66	LEAD CONSUMER NOTICE (LCR)	1/1/2022		665
726	LAKESHORE ESTATES WATER ASSN	66	LEAD CONSUMER NOTICE (LCR)	11/1/2024		568
1091	LEATHERWOOD VIEW ESTATES	51	INITIAL TAP SAMPLING (LCR)	7/1/2012		38
430	MARKED TREE WATERWORKS	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	7/1/2024		2610
680	MT SHERMAN WATER ASSOCIATION	66	LEAD CONSUMER NOTICE (LCR)	11/1/2024		903
175	NORTHERN OHIO WATER ASSOC	66	LEAD CONSUMER NOTICE (LCR)	11/1/2024	11/24/2025	720
530	OZARK ACRES WATER ASSOCIATION	66	LEAD CONSUMER NOTICE (LCR)	6/1/2020		830
172	PICKENS WATERWORKS	66	LEAD CONSUMER NOTICE (LCR)	5/1/2025		49
018	PORTLAND WATERWORKS	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	7/1/2025		625
389	ROE WATERWORKS	66	LEAD CONSUMER NOTICE (LCR)	12/1/2021		124
639	WALKERVILLE WATER ASSOCIATION	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	7/1/2024	5/22/2025	547

PWS type: NP

PWS ID	System Name	SDWIS Code	Violation Definition	Violation Date	RTC date	Retail
324	145TH STREET WATER SEWER	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	12/31/2004		461
777	BRUSHY ISLAND WATER AUTHORITY	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	11/25/2003		789
N0020	EL DORADO CHEMICAL COMPANY	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	1/1/2008		150
N0024	FOURCHE VALLEY SCHOOL	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	11/25/2003		185
N0043	HOWARD COUNTY CHRISTIAN SCHOOL	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	12/31/2000		200
N0130	JOYFUL NOISE	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	12/31/2002		50
229	MC CASKILL WATERWORKS	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	12/31/2002		100
N0047	OAK RIDGE CENTRAL SCHOOL	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	2/25/2001		250
113	PINE REST MOBILE HOME PARK	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	1/1/2007		53
892	RIVERWALK APARTMENTS	51	INITIAL TAP SAMPLING (LCR)	2/28/2005		350
N0236	SALINE COUNTY CAREER CENTER	51	INITIAL TAP SAMPLING (LCR)	11/25/2003		200
N0236	SALINE COUNTY CAREER CENTER	51	INITIAL TAP SAMPLING (LCR)	8/25/2004		200
806	WIEDERKEHR VILLAGE WATER DEPT	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	1/1/2010		77
806	WIEDERKEHR VILLAGE WATER DEPT	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	7/1/2010		77

806	WIEDERKEHR VILLAGE WATER DEPT	52	FOLLOW-UP OR ROUTINE TAP M/R (LCR)	7/1/2011	77
806	WIEDERKEHR VILLAGE WATER DEPT	66	LEAD CONSUMER NOTICE (LCR)	1/14/2016	77

**Appendix H - Lead & Copper Rule Monitoring & Treatment Technique
Violations***PWS type: NTNC*

PWS ID	System Name	SDWIS Code	Violation Definition	Violation Date	RTC date	Retail
T1065	GREENWICH CENTER	66	LEAD CONSUMER NOTICE (LCR)	11/1/2024		30

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
PWS type:PWS type:		
1250	ABUNDANT BLESSINGS	
1270	CARTER ICE/WATER 2	
1271	CARTER ICE/WATER 3	
1269	CARTER ICE/WATER1	
1265	DOGWOOD ESCAPE RV PARK	
1233	NEWTH AQUA STAR MOUNTAIN HOME	
1232	NEWTH ICE HOUSE MOUNTAIN HOME	
1275	NORTH CENTRAL CRAWFORD COUNTY WATER SYS.	
1281	THE BUZZ COFFEE	
PWS type:PWS type: Bottler		
N0235	ALEXA SPRINGS WATER COMPANY	25
N0080	BLACK BEAR SPRINGS	25
1013	C. G. Roxane	25
N0073	MT VALLEY SPRING CO	25
N0084	WILDERNESS VALLEY SPRING	25
PWS type:PWS type: C		
811	ACORN RURAL WATER ASSN	1975
315	ADC - CUMMINS UNIT MAINT	3800
303	ALICIA WATER SYSTEM	146
144	ALMA WATERWORKS	6123
764	ALPINE WATER ASSOCIATION	750
167	ARKANSAS CITY WATERWORKS	360
667	ARSENAL WATER SYSTEM	600
527	ASH FLAT WATER COMPANY	1186
320	ASHDOWN WATERWORKS	4261
441	ATKINS WATER SYSTEM	4439
597	AUGUSTA WATERWORKS	2228
584	BALD KNOB WATERWORKS	2911
785	BARKADA WATER ASSOCIATION	403
415	BARTON LEXA WATER ASSOCIATION	3642
250	BATESVILLE WATER UTILITIES	15621
1178	BAXTER-MARION REGIONAL WATER ASSOCIATION	465
129	BAY WATERWORKS	1938
038	BEAVER WATER DISTRICT	54
844	BEAVERFORK PWA	4220
262	BEEDEVILLE WATER WORKS	98
039	BELLA VISTA P.O.A.	39419
899	BENTON COUNTY WATER AUTHORITY4	673
037	BENTON COUNTY WATER DISTRICT #1	6730

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
484	BENTON WATERWORKS	30681
041	BENTONVILLE WATER UTILITIES	51250
871	BENTON-WASHINGTON REGIONAL PWA	30
060	BERGMAN WATERWORKS	3285
074	BERRYVILLE WATERWORKS	6813
411	BIGELOW WATERWORKS	605
476	BIGGERS WATERWORKS	404
448	BISCOE WATERWORKS	388
302	BLACK ROCK WATERWORKS	1034
233	BLEVINS WATERWORKS	383
365	BLYTHEVILLE WATERWORKS	12981
126	BONO WATERWORKS	2550
336	BOONEVILLE DEVELOPMENT CENTER	275
326	BOONEVILLE WATERWORKS	3847
179	BOWSER WATER ASSN	635
294	BRADLEY WATERWORKS	567
131	BROOKLAND WATERWORKS	4283
837	BRUNNER HILL WATER ASSOC	1265
486	BRYANT WATERWORKS	19607
671	BUFFALO ISLAND REG WATER DIST	3055
352	BULL SHOALS WATER SYSTEM	2835
366	BURDETTE WATERWORKS	798
338	CABOT WATERWORKS	30063
515	CADDO VALLEY WATERWORKS	535
532	CALDWELL WATER	1585
919	CALHOUN COUNTY WATER ASSN	1591
003	CALICO ROCK WATERWORKS	1603
551	CALION WATER WORKS	494
404	CAMDEN WATERWORKS	13275
877	CAMP ROBINSON	1500
127	CARAWAY WATERWORKS	1432
339	CARLISLE WATERWORKS	2300
675	CARROLL-BOONE WATER DISTRICT	20
165	CARTHAGE WATER AND SEWER	362
130	CASH WATERWORKS	342
526	CAVE CITY WATERWORKS	3045
043	CAVE SPRINGS WATERWORKS	5365
138	CEDARVILLE WATERWORKS FBCC	8529
213	CENTER GROVE WATER ASSOCIATION	3858
465	CENTRAL ARKANSAS WATER	368455

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
883	CENTRAL ARKANSAS WATER-PARON	2071
503	CENTRAL CITY WATER DEPARTMENT	1227
845	CENTRAL LOGAN COUNTY PWFB	1268
200	CHARLESTON WATERWORKS	3386
521	CHEROKEE VILLAGE WATER ASSOC	4780
158	CHERRY VALLEY WATERWORKS	690
403	CHIDESTER WATERWORKS	336
741	CLARK CO COUNTRY WATER FACILIT	2403
148	CLARKEDALE-JERICHO WATER ASSOC	925
289	CLARKSVILLE CONNECTED UTILITIES	9410
722	CLAY CO REG WATER DISTRICT	5633
069	CLEVELAND CO RURAL WATER USERS ASSOC	2244
564	CLINTON WATERWORKS	10280
533	COLT WATER ASSOCIATION	997
147	CONCORD WATER & SEWER PFB	3071
189	CONWAY WATER SYSTEM	65218
927	CORINTH VALLEY WATER SYSTEM	33
028	COTTER WATERWORKS	1233
439	COVE WATERWORKS	651
340	COY WATERWORKS	218
149	CRAWFORDSVILLE WATERWORKS	2103
873	CRESTWOOD MOBILE HOME PARK	48
459	CROSS COUNTY RURAL WATER SYS	8750
017	CROSSETT WATER COMMISSION	7900
249	CUSHMAN WATER SYSTEM	1423
601	DARDANELLE WATERWORKS	4517
224	DELAPLAINE WATERWORKS	183
367	DELL WATERWORKS	1077
199	DENNING WATERWORKS	712
008	DEWITT WATERWORKS	3208
061	DIAMOND CITY WATER	1290
269	DIAZ WATERWORKS	1215
243	DIERKS WATER WORKS	1317
585	DOGWOOD WATER ASSOCIATION	1345
714	DORCHEAT WATER ASSOCIATION	1860
698	Dota Public Water Authority	2722
444	DOVER WATERWORKS	1797
730	DYESS RURAL WATER	254
376	DYESS WATERWORKS	430
886	E CASS WATER SUPPLY CORP	150

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
646	EAST END WATER	5954
809	EAST LOGAN CO RURAL WATER	2263
458	EAST PRAIRIE CNTY PUBLIC WATER AUTHORITY	545
350	EDGEWOOD BAY WATER	308
418	ELAINE WATERWORKS	1233
567	ELKINS WATERWORKS	3905
111	EMERSON WATERWORKS	1145
393	EMMET WATERWORKS	550
341	ENGLAND WATERWORKS	2477
183	ENON WATER ASSOCIATION	488
075	EUREKA SPRINGS WATERWORKS	4053
525	EVENING SHADE WATERWORKS	750
544	FAIRCREST WATER ASSOCIATION	1244
569	FAYETTEVILLE WATERWORKS	116398
514	FCMTC WATERWORKS	500
545	FELSENTHAL WATER AND SEWER	150
351	FLIPPIN WATERWORKS	3870
635	FORDYCE RURAL WATER ASSOC	1274
004	FORREST CITY WATERWORKS	9986
507	FORT SMITH WATER UTILITIES	86209
257	FRANKLIN WATERWORKS	192
1077	FRANKLIN-SEBASTIAN PWA	0
812	FREEDOM PUBLIC WATER AUTHORITY	1858
814	FULTON COUNTY WATER AUTHORI	2411
231	FULTON WATERWORKS	365
645	FURLOW WATER ASSOCIATION	3073
047	GARFIELD WATERWORKS	758
034	GASSVILLE WATERWORKS	2040
693	GATEWAY PUBLIC WATER AUTHORITY	2325
048	GENTRY WATERWORKS	7910
699	GENTRYVILLE PUBLIC WATER AUTH	469
009	GILLETT WATER DEPT	655
658	GILLHAM REGIONAL WATER DIST	3
516	GILLHAM WATERWORKS	255
422	GLENWOOD WATER DEPARTMENT	2068
316	GOULD MUNICIPAL WATER-SEWER	837
317	GRADY WATERWORKS	313
738	GRAND PRAIRIE REGIONAL WATER	15204
759	GRANGE-CALAMINE WATER ASSOC	3015
437	GRANNIS WATERWORKS	548

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
T1101	GRASSY KNOB SUBORDINATE SD	88
051	GRAVETTE WATERWORKS	4900
076	GRAY ROCK WATER ASSOCIATION	750
077	GREEN FOREST WATERWORKS	6265
191	GREENBRIER WATERWORKS	12938
097	GREENWAY WATERWORKS	322
504	GREENWOOD WATERWORKS	9905
267	GRUBBS WATERWORKS	823
626	GUION WATER DEPARTMENT	249
087	GURDON WATERWORKS	2988
192	GUY WATERWORKS	2438
505	HACKETT WATERWORKS	1090
015	HAMBURG WATERWORKS	5600
070	HAMPTON WATERWORKS	1906
273	HARDIN WATER ASSOCIATION	4600
524	HARDY WATERWORKS	1101
071	HARRELL WATERWORKS	296
431	HARRISBURG WATERWORKS	2824
062	HARRISON WATERWORKS	17455
506	HARTFORD WATERWORKS	725
286	HARTMAN WATERWORKS	947
488	HASKELL WATER SYSTEM	4000
436	HATFIELD WATERWORKS	641
602	HAVANA WATERWORKS	1411
452	HAZEN WATERWORKS	1301
104	HEBER SPRINGS WATER SYSTEM	14015
067	HERMITAGE WATERWORKS	830
885	HIGHFILL WATER DEPARTMENT	3970
672	Highland Public Water Authority	2390
230	HOPE WATER LIGHT COMM	11500
518	HORATIO WATERWORKS	1278
255	HORSESHOE BEND WATERWORKS	3217
151	Horseshoe Lake Utilities	603
236	HOT SPRING CO WATER ASSOC	3528
209	HOT SPRINGS UTILITIES	75343
208	HOT SPRINGS VILLAGE WATER	15985
414	HOUSTON WATERWORKS	650
011	HUGHES COMMUNITY WATER ASSOC	2195
531	HUGHES WATERWORKS	987
508	HUNTINGTON WATERWORKS	782

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
348	HUNTSVILLE WATERWORKS	3508
107	HWY 63 WATER ASSOCIATION	7187
145	HWY 71 WATER DISTRICT #1 PWA	6275
300	IMBODEN WATERWORKS	825
466	JACKSONVILLE WATERWORKS	32875
513	JAMES FORK REGIONAL WATER	11538
397	JASPER WATERWORKS	648
276	JEFFERSON PUBLIC WATER AUTHORITY	2551
372	JOINER WATERWORKS	486
124	JONESBORO WATER SYSTEM	81888
582	JUDSONIA WATERWORKS	2956
373	KEISER WATERWORKS	810
588	KENSETT WATERWORKS	1624
337	KEO WATER WORKS	388
140	KIBLER WATER SYSTEM	1815
821	KIMZEY REGIONAL WATER DISTRICT	12718
827	KINGS HILL ESTATES	28
099	KNOBEL WATERWORKS	249
287	KNOXVILLE WATERWORKS	2087
706	KROOKED CREEK WATER ASSN	2250
684	LACEY-LADELLE WATER ASSOCIATION	1438
277	LADD WATER ASSOCIATION	1773
483	LAFE REGIONAL WATER DISTRIBUTION DISTRICT	2583
031	LAKE BULL SHOALS ESTATES WATER	60
080	LAKE CHICOT WATER SUPPLY ASSOCIATION	1909
780	LAKE LUCERNE ESTATES	65
081	LAKE VILLAGE WATERWORKS	2065
822	LAKESIDE WATER ASSOCIATION	1876
027	LAKEVIEW MIDWAY PUBLIC WATER AUTHORITY	3918
793	LAURELWOOD HOMEOWNERS ASSOCIATION	105
510	LAVACA WATERWORKS	3650
688	LAWRENCE CO REG WATER DIST	7469
548	LAWSON-URBANA WATER ASSOC	1108
362	LEACHVILLE WATERWORKS	2030
313	LEE COUNTY WATER ASSOCIATION	3770
218	LEOLA WATERWORKS	564
297	LEWISVILLE WATERWORKS	1951
471	LIBERTY - WOODSON / HENSLEY WAT	1004
272	LIBERTY UTILITIES	43438
572	LINCOLN WATERWORKS	6690

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
716	LISBON WATER ASSOCIATION	487
808	LITTLE PORTION HERMITAGE	25
787	LITTLE RIVER CO RDA	4279
467	LITTLE RIVER COUNTRY CLUB	120
371	LITTLE RIVER WATER ASSOCIATION	619
912	LOCKE-FERN DOLLARD RD WW PFB	1135
517	LOCKESBURG WATERWORKS	739
102	LOCUST BAYOU WATER ASSOCIATION	531
1076	LONOKE WHITE PUBLIC WATER AUTH	0
049	LOST BRIDGE VILL WAT-SEW DIST	1010
406	LOUANN WATERWORKS	170
292	LUDWIG WATER ASSOCIATION	1610
718	LURTON-PELSOR WATER ASSOC	345
713	LYDESDALE WATER ASSOCIATION	405
299	LYNN WATERWORKS	773
803	MADISON CO REGIONAL WATER	4
349	MADISON CO WATER FACILITIES BD	11435
327	MAGAZINE WATERWORKS	1000
246	MAGNESS WATER ASSOCIATION	391
241	MAGNET-BUTTERFIELD WATER AUTHORITY	1838
109	MAGNOLIA WATERWORKS	11657
237	MALVERN WATERWORKS	14410
206	MAMMOTH SPRING WATERWORKS	1777
378	MANILA WATERWORKS	4165
509	MANSFIELD WATERWORKS	2367
310	MARIANNA WATERWORKS	3238
770	MARION COUNTY REG WATER DIST	0
225	MARMADUKE WATERWORKS	1410
501	MARSHALL WATERWORKS	2550
001	MARYSVILLE WATER ASSOCIATION	867
464	MAUMELLE WATER CORPORATION	2832
193	MAYFLOWER WATERWORKS	7390
098	MC DOUGAL WATERWORKS	271
705	MC NEIL RURAL WATER ASSOC	900
110	MC NEIL WATERWORKS	515
589	MC RAE WATERWORKS	870
170	MCGEHEE WATERWORKS	3849
256	MELBOURNE WATERWORKS	4126
438	MENA WATER DEPT	5604
725	Mid-Arkansas Utilities PWA	11148

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
786	MILL POND VILLAGE MHP	160
1141	MILLER COUNTY PUBLIC WATER AUTHORITY	803
773	MILLTOWN-WASHBURN WATER USERS	4325
242	MINERAL SPRINGS WATERWORKS	1364
169	MITCHELLVILLE WATERWORKS	293
128	MONETTE WATERWORKS	1385
184	MONTICELLO WATER DEPARTMENT	8442
709	MORRISON BLUFF WATER SYSTEM	312
002	MOUNT HOLLY WATERWORKS	384
668	MOUNT OLIVE WATER ASSOCIATION	6308
025	MOUNTAIN HOME WATERWORKS	19618
454	MOUNTAIN TOP WATER ASSOCIATION	9253
542	MOUNTAIN VIEW WATERWORKS	6153
258	MT PLEASANT WATERWORKS	1338
1069	N E WHITE COUNTY PUBLIC FACILITIES BOARD	0
867	N GARLAND CO REG WATER DIST	7913
805	NASHVILLE RURAL WATER AUTHORITY	7291
244	NASHVILLE WATERWORKS	4153
673	NE MISSISSIPPI CO WATER ASSOC	1040
1070	NEAPWA	2
683	NEW HOPE WATER ASSOCIATION	1136
248	NEWARK WATERWORKS	1091
264	NEWPORT WATERWORKS	6204
035	NORFORK WATERWORKS	918
391	NORMAN WATERWORKS	750
554	NORPHLET WATERWORKS	1112
033	NORTH EAST PUBLIC WATER AUTH	4690
012	NORTH LAGRUE WATER ASSOC	284
583	NORTH WHITE CO RURAL WATER PFB	5215
007	NORTHEAST DEWITT WATER ASSOC	610
558	OAK MANOR WATER ASSOCIATION	339
676	OAKHILLS SURB IMPROVMENT DIST	133
322	OGDEN WATERWORKS	487
473	O'KEAN WATERWORKS	230
559	Old Union Public Water Authority	1200
120	OPPELO WATER DEPARTMENT	1300
802	OUTSIDE KINGSLAND WATER ASSOC	308
259	OXFORD WATERWORKS	1402
227	OZAN WATERWORKS	425
998	Ozark Mtn Regional PWA	0

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
201	OZARK WATERWORKS	4368
222	PARAGOULD MUNICIPAL UTILITIES	31188
560	PARKERS CHAPEL PUBLIC WATER	2391
412	PERRY WATER SYSTEM	736
234	PERRYTOWN WATERWORKS	130
413	PERRYVILLE WATERWORKS	5550
251	PFEIFFER WATER AUTHORITY	3343
090	PIGGOTT WATERWORKS	4620
1240	PINE TOP WATER FACILITIES BOARD	55
720	PLEASANT GROVE	2613
202	PLEASANT VIEW WATER FAC BOARD	1708
092	POLLARD WATERWORKS	247
305	PORTIA WATERWORKS	586
217	POYEN WATERWORKS	875
573	PRAIRIE GROVE WATERWORKS	9615
216	PRATTSVILLE WATERWORKS	1341
394	PRESCOTT WATERWORKS	4500
561	QUINN WATER ASSOCIATION	729
306	RAVENDEN WATERWORKS	621
093	RECTOR WATERWORKS	2280
279	REDFIELD WATERWORKS	2823
475	REYNO WATERWORKS	437
835	RICHWOODS WATER ASSOCIATION	1663
1297	River Chase Water Association	96
674	RIVERSOUTH RURAL WATER DIST	4275
239	RIVIERA UTILITIES	1800
252	Rock Moore Water Authority	3462
055	ROGERS WATER UTILITIES	81443
395	ROSSTON WATER DEPARTMENT	750
678	S P G WATER ASSOCIATION	1730
204	SALEM WATERWORKS	1639
491	SALINE CO WW SS PFB	2538
493	SARDIS WATER ASSOCIATION	15660
758	SDM WATER ASSOCIATION	520
870	SE BRADLEY CO WATER ASSN	2713
590	SEARCY WATERWORKS	28196
511	SEBASTIAN LAKE UTILITY OPERATING COMPANY	298
304	SEDGWICK WATERWORKS	249
868	SEVIER CO WATER ASSOCIATION	5365
800	SHANNON HILLS WATER DEPT	3443

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
215	SHERIDAN WATERWORKS	4605
407	SHUMAKER PUBLIC SERVICE CO	1399
528	SIDNEY WATER SYSTEM	350
056	SILOAM SPRINGS WATERWORKS	21430
555	SMACKOVER WATERWORKS	2821
851	SOUTH LOGAN COUNTY WATER	2087
815	SOUTH MOUNTAIN WATER ASSN	948
978	SOUTH PIKE CO. WATER	755
219	SOUTH SHERIDAN WATER ASSOC	3887
792	SOUTHERN HILLS WATER SYSTEM	25
254	SOUTHSIDE PUB WATER AUTHORITY	9108
495	SOUTHWEST WATER USERS LLC	9573
166	SPARKMAN WATERWORKS	1325
575	SPRINGDALE WATER UTILITIES	98948
836	ST FRANCIS RIVER REG WATER DD	2465
537	ST FRANCIS RURAL WATER ASSOC	1103
094	ST FRANCIS WATER SYSTEM	208
318	STAR CITY WATER WATERWORKS	2173
755	STARLIGHT ESTATES	67
405	STEPHENS WATERWORKS	1100
013	STUTTGART WATERWORKS	7393
355	SUMMIT WATERWORKS	675
628	SW BOONE COUNTY WATER ASSOC	4558
852	SW WARREN WATER ASSOCIATION	765
185	SW WHITE COUNTY WATER ASSN	12173
265	SWIFTON WATERWORKS	1013
045	SYLVAN SHORES SD WATERWORKS	65
824	TABLE ROCK LAKE WATER USERS, INC.	27
360	TEXARKANA WATER UTILITIES	50815
072	THORNTON WATERWORKS	900
186	TILLAR WATERWORKS	225
618	TOLLETTE WATER	346
566	TONTITOWN WATERWORKS	7355
1301	TRI COUNTY RWDD - HECTOR	4310
782	TRI-COUNTY WATER DISTBR DIST	20394
435	TRUMANN WATERWORKS	10000
825	TULIP - PRINCETON WATER ASSN	1083
220	TULL WATER	1987
579	TUMBLING SHOALS WATER ASSOC	6608
426	TYRONZA WATERWORKS	958

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
451	ULM WATERWORKS	250
690	US AIR FORCE BASE LITTLE ROCK	8618
727	VAN BUREN COUNTY PWA	3500
142	VAN BUREN WATERWORKS	22725
162	VANNDALE-BIRDEYE WATER ASSOC	2174
380	VICTORIA WATER ASSOCIATION	33
115	VILLAGE WATER ASSOCIATION	379
195	VILONIA WATERWORKS	24690
205	VIOLA WATERWORKS	336
112	WALDO WATERWORKS	1630
498	WALDRON WATERWORKS	3550
858	WALKER CREEK STATELINE RWA	1340
116	WALKER WATER ASSOCIATION	1182
298	WALNUT HILL WATER ASSOCIATION	275
066	WARREN WATERWORKS	6001
574	WASHINGTON WATER AUTHORITY WWA	20140
232	WASHINGTON WATER SYSTEM	142
606	WATALULA WATER ASSOCIATION	2278
284	WATSON CHAPEL WATER ASSOC	5590
174	WATSON WATERWORKS	166
428	WEINER WATERWORKS	973
103	WESSON-NEWELL WATER ASSOC	658
878	WEST ASHLEY COUNTY WATER ASSN	683
577	WEST FORK WATERWORKS	3178
704	WESTERN GREENE COUNTY R W D	7095
535	WHEATLEY WATERWORKS	573
804	WHELEN SPRINGS WATER DEPT	559
440	WICKES WATERWORKS	2014
538	WIDENER WATERWORKS	507
686	WILBURN WATER ASSOCIATION	668
562	WILDWOOD WATER ASSOCIATION	1350
650	WILLISVILLE WATERWORKS	430
370	WILSON WATER SYSTEM	1336
188	WINCHESTER WATERWORKS	457
332	WINSLOW WATERWORKS	1433
783	WIRE ROAD WATER SYSTEM	830
700	WKMM RURAL WATER ASSOCIATION	310
410	WYE MOUNTAIN WATER ASSOCIATION	1963
163	WYNNE WATERWORKS	8391
356	YELLVILLE WATERWORKS	2598
319	YORKTOWN WATER ASSOCIATION	7364

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
PWS type: N		
T0832	ANCHOR POINTE	150
T0031	ARK POST NATIONAL MEMORIAL	100
1107	ARK S/P BEECH POINT CAMPGROUND	25
T0068	BAYOU RESORT	25
T1070	Benny's Country Store	25
1295	Black Diamond Studio	
1001	Blue Heron Campground	25
T0079	BLUE LADY RESORT	45
T0350	BLUE WATER'S RESORT, LLC	119
T1082	BNR U2-02 DILLARDS FERRY	260
T1022	BNR U2-48 RUSH CAMPGROUND	25
T0098	BNRU2-01 BUFFALO POINT CAMPGROUND	70
T0885	BOLL WEEVIL	300
T0087	BOY SCOUT CAMP ORR	300
T1083	BRADY MOUNTAIN RESORT & MARINA	1000
T0965	BUFFALO NATRV U4-08 OZARK CG	25
T0961	BUFFALO NATRV U4-24 KYLES CG	25
T0963	BUFFALO NRVU4-02LOST VALLEYCG	25
T0096	BUFFALO NRVU4-06 UPPER PRUITT	25
T1047	BUFFALO OUTDOOR CENTER	25
T0906	BUFFALO RV TYLER BEND CGU3-13	25
T0097	BUFFALO RV TYLER BEND MTU3-12	25
T0102	BYRD'S ADVENTURE CENTER, INC.	25
1242	CAMP HARVEST	25
T1045	CAMP KARLTON KEMP	140
T0120	CAMP KIA KIMA	500
973	CAMP WAR EAGLE	700
986	CEDAR GLADES PARK	25
T0431	CEDAR VALLEY INC	250
1272	DOLLAR GENERAL 24780	25
1247	DOLLAR GENERAL STORE (HOT SPR DG #17027)	25
1246	DOLLAR GENERAL STORE 16417	25
1256	Dollar General Store 21210	25
1261	Dollar General Store 22097	25
1282	Dollar General Store 30726	25
T1076	ECHO CANYON RESORT & MARINA	180
T1107	EUREKA SPRINGS PARKS & REC	100
1251	FOURCHE MOUNTAIN ADVENTURES CAMPGROUND	50

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
942	FRED BERRY CONSERVATION ED CTR	25
T0231	GASTON'S WHITE RIVER RESORT	550
981	HARVEST CHURCH	75
T0258	HOLIDAY HILLS RESORT	90
T0915	HOT SPR NAT PK HAPPY HOLLOW SP	25
T0916	HOT SPR NAT PK WHITTINGTON SPR	25
T0259	HOT SPRINGS NATIONAL PARK	25
T0261	HWY 27 FISHING VILLAGE	50
T0714	HWY 27 REC AREA	25
1279	King's Crossing RV Campground	50
T0308	KOA CAMPGROUND STORE	40
1273	LAGRANGE LAVENDER CO.	25
993	Lake Shore Cabins	78
T0316	LAKESIDE COUNTRY CLUB	120
989	Live Edge Bar and Grill	25
1090	LOST VALLEY CANOE AND LODGING	25
T0341	MANY ISLAND CAMP	200
1005	Oak Hill Lodge SGT	25
936	PEACE RETREAT	25
T0439	PONCA BIBLE CAMP	25
1262	River Run Resort	25
T1054	RIVERLAKE OUTDOOR Center	25
T1037	RIVERSIDE RESORT	250
T0467	RIVERSIDE RESORT AT KINGS RIVER	25
T1097	Roost Your wheels	100
T1085	RUSSELL'S RV	175
925	SHADY OAK RV PARK	124
T0513	SPRING RIVER OAKS CAMP	25
T1109	SUGAR CREEK LODGE	25
T0526	SUPPLY COUNTRY STORE	150
T0588	USCOE BSWP109 TUCKER HOLLOW	40
T0589	USCOE BSWP110 TUCKER HOLLOW	25
T0592	USCOE BSWP129 BUCK CREEK	25
T0594	USCOE BSWP133 HIGHWAY 125	25
T0602	USCOE BWP 18 LOST BRIDGE SOUTH	25
T0601	USCOE BWP17 LOST BRIDGE	25
T0609	USCOE BWP33 LOST BRIDGE	25
T0619	USCOE DG LENOX MARCUS	25
T0622	USCOE DG OZAN POINT	25
T1053	USCOE NF HOWARD COVE	100

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
T1035	USCOE NF PANTHER BAY	66
T0689	USCOE NFWP12 ROBINSON POINT	306
T0691	USCOE NFWP15 PANTHER BAY	66
T0695	USCOE NFWP25 BIDWELL POINT	144
T0696	USCOE NFWP29 GAMALIEL	192
T0709	USCOE OC - BRADY MTN	100
T0718	USCOE OC - LITTLE FIR	100
T0763	USFS ALBERT PIKE REC AREA	25
T0770	USFS BLANCHARD	25
T0786	USFS GUNNER POOL	25
T0788	USFS HORSEHEAD BATHHOUSE	25
T0797	USFS LITTLE PINES REC AREA	25
T0806	USFS REDDING	25
T0811	USFS SHADY LAKE REC AREA 16666	50
T0814	USFS SHORES LAKE	25
T0821	USFS WHITE ROCK	35
970	VENTRIS TRAILS END RESORT	50
949	WEST SHORE RESTAURANT	150
T0852	WHITE RIVER CAMPGROUND	250
PWS type:PWS type: P		
N0129	AHTD MARION COUNTY	25
N0022	ALBEMARLE CORPORATION SOUTH	550
N0021	ALBEMARLE CORPORATION WEST	150
N0057	AMMUNITION OPERATIONS, LLC	650
T1110	ARK STATE PARK MT MAGAZINE	142
1254	CARTHAGE FOREST PRODUCTS	140
N0237	CHRISTIAN MINISTRY ACADEMY	300
N0052	CLEARWATER PAPER CORPORATION	339
N0009	ENTERGY - INDEPENDENCE	150
1266	GARLAND TOWERS APARTMENTS	74
N0214	GEORGIA PACIFIC WOOD PRODUCTS LLC	135
N0029	LANXESS Corporation	144
932	MOUNTAIN DEVELOPMENT	50
N0046	Nat Ctr For Toxicological Res	600
N0188	NW ARKANSAS REGIONAL AIRPORT	3538
1206	PECO Foods	30
N0189	R V A F TEXARKANA	120
N0032	SUZANO PACKAGING INC, PINE BLUFF	960
N0109	SW REGION WILDERNESS CAMP	41
N0088	THE GREAT PASSION PLAY	450
1221	VETERANS HEALTH CARE SYSTEM OF THE OZARKS	2254

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
PWS type: V		
1211	F & L ICE HOUSE ROSE BUD	30
N0239	GLACIER ALB4111 TEXARKANA	30
N0244	GLACIER BG0494 CROSSETT	30
N0242	GLACIER BG2195 ELDORADO	30
N0245	GLACIER BG2239 CAMDEN	30
N0243	GLACIER BG2371 MAGNOLIA 2371	30
914	GLACIER BG4365 ASHDOWN	30
1114	GLACIER BGC096 ARKADELPHIA	30
1117	GLACIER BGC619 HOPE	30
1143	GLACIER FAMD4009 RUSSELLVILLE	30
1165	GLACIER FAMD4372 RODGERS	30
1046	GLACIER FG37 MARIANNA	80
1124	GLACIER HM1 SPRINGDALE	30
1084	GLACIER MERC101 SPRINGDALE	30
1230	GLACIER SF2752 GASSVILLE	30
1213	JUNIOR'S POLAR ICE BEEBE	30
1300	NWS INC WF1017 ROGERS	30
1298	NWS inc. Akins NF Rogers	30
1198	NWS INC. WF0317 LITTLE ROCK	30
1220	NWS INC. WF0330 FAYETTEVILLE	30
1216	OZARK ICE HOUSE COTTER	30
909	PRIMO WMSC0033 NASHVILLE	30
1071	PRIMO WMSC0171 CAMDEN	80
1260	Primo BG762 Red Field	30
1276	PRIMO CVS10519 SPRINGDALE	
1234	PRIMO GLACIER HCP108 SPRINGDALE	30
1235	PRIMO GLACIER HF103 GREEN FOREST	30
1237	PRIMO GLACIER HF115 ELKINS	30
1238	PRIMO GLACIER HF122 CENTERTON	30
1268	PRIMO GLACIER NW1 HARRISON	
1066	PRIMO HARPS124 FAYETTEVILLE	30
N0162	PRIMO HF133 HUNTSVILLE	30
N0212	PRIMO HF135 MOUNTAIN HOME	30
1277	PRIMO HH METALTON	
1287	Primo Kroger409 Jonesboro	30
1291	PRIMO KROGER469 WEST MEMPHIS	30
1285	Primo Kroger590 Hot Springs	30
1290	PRIMO KROGER606 MAUMELLE	30

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
1286	Primo Kroger614 Jacksonville	30
1289	Primo Kroger622 Little Rock	30
1288	Primo Kroger623 Little Rock	30
1284	PRIMO KROGER625 CONWAY	30
1283	PRIMO KROGER629 BENTON	30
1294	Primo Kroger652 Conway	30
1293	Primo Kroger6929 North Little Rock	30
N0173	PRIMO REFILL LLC SILOAM SPRINGS IGA	30
1113	PRIMO REFILL LLC WMNM5737 FAYETTEVILLE	30
1028	PRIMO REFILL LLC WMSC 4460 NLR	30
1011	PRIMO REFILL LLC WMSC0133 Ashdown	30
N0174	PRIMO REFILL LLC FAYETTEVILLE WAL359	30
1149	PRIMO REFILL WMSC157 SEARCY	30
N0148	Primo Russellville Harps	30
N0223	PRIMO WMNM 2742 SPRINGDALE	80
1207	PRIMO WMNM 4375 SPRINGDALE	30
1182	PRIMO WMNM 4686 BENTONVILLE	80
1174	PRIMO WMNM2431 SEARCY	30
1201	PRIMO WMNM2686 BENTONVILLE	30
N0201	PRIMO WMNM2745 FAYETTEVILLE	30
1218	PRIMO WMNM3164 BENTONVILLE	30
1189	PRIMO WMNM4128 RUSSELLVILLE	30
1208	PRIMO WMNM4376 BENTONVILLE	30
1224	PRIMO WMNM4516 FAYETTEVILLE	30
1214	PRIMO WMNM4579 FT. SMITH	30
1068	PRIMO WMNM5738 SPRINGDALE	30
1225	PRIMO WMNM5780 PARAGOULD	30
1228	PRIMO WMNM5789 HOT SPRINGS	30
1229	PRIMO WMNM5790 HOT SPRINGS	30
1185	PRIMO WMNM6953 CENTERTON	80
1194	PRIMO WMNM6960 SILOAM SPRINGS	30
1197	PRIMO WMNM6975 CABOT	30
1187	PRIMO WMNM7242 FARMINGTON	30
1196	PRIMO WMNM7317 GREENBRIAR	30
965	PRIMO WMS0058 RUSSELLVILLE	80
1151	PRIMO WMSC 0008 MORRILTON	30
N0218	PRIMO WMSC0004 SILOAM SPRINGS	30
N0145	PRIMO WMSC0005 CONWAY	30
N0230	PRIMO WMSC0011 MT HOME	30
N0211	PRIMO WMSC0016 VAN BUREN	30

Thursday, May 14, 2026

Appendix I

Appendix I - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
1181	PRIMO WMSC0018 NEWPORT	30
N0198	PRIMO WMSC0024 JACKSONVILLE	30
N0161	PRIMO WMSC0036 PARAGOULD	30
N0216	PRIMO WMSC0052 HOT SPRNGS	30
N0168	PRIMO WMSC0054 SPRINGDALE	60
1205	PRIMO WMSC0055 BOONEVILLE	30
N0140	PRIMO WMSC0067 MENA	30
911	PRIMO WMSC0068 WYNNE	30
N0159	PRIMO WMSC0076 BERRYVILLE	30
1153	PRIMO WMSC0083 MAGNOLIA	30
N0139	PRIMO WMSC0085 BENTON	30
N0156	PRIMO WMSC0100 BENTONVILLE	30
N0142	PRIMO WMSC0102 STUTTGART	30
N0219	PRIMO WMSC0119 BATESVILLE	30
947	PRIMO WMSC0127 MALVERN	120
N0165	PRIMO WMSC0141 FT. SMITH	30
N0170	PRIMO WMSC0144 FAYETTEVILLE	30
N0166	PRIMO WMSC0160 ASH FLAT	30
939	PRIMO WMSC0167 CROSSETT	30
N0224	Primo WMSC0261 Hot Springs	30
963	PRIMO WMSC0296 DARDANELLE	50
977	PRIMO WMSC0358 ALMA	30
1195	PRIMO WMSC0373 HUNTSVILLE	30
N0154	PRIMO WMSC0530 ELDORADO	30
N0152	PRIMO WMSC0714 W.HELENA	30
N0220	PRIMO WMSC0788 CLINTON	30
N0221	PRIMO WMSC1065 HOPE	30
1150	PRIMO WMSC1105 NLR	30
964	PRIMO WMSC1114 MTN VIEW	30
944	PRIMO WMSC1147 FLIPPIN	30
1179	PRIMO WMSC3168 CONWAY	30
N0222	Primo WMSC3230 Bryant	30
N0240	PRIMO WMSC3231 GREENWOOD	30
918	PRIMO WMSC3331 PINE BLUFF	30
974	PRIMO WMSC336 SHERIDAN	30
1180	PRIMO WMSC4168 BEEBE	30
929	PRIMO WMSC5244 LR	30
934	Primo WMSC5433 HSV	30
1167	PRIMO WMSC5706 LITTLE ROCK	80
1186	PRIMO WNM6971 PEA RIDGE	30
1244	TIGER ICE 1 CHARLESTON	30

Appendix J - Enforcement Actions

PWS type: C

PWS	System Name	Enforcement Action	Date Issued	Rule Violated
890	AUTUMN ACRES MHP	Warning of Administrative Order	11/24/2025	lic
887	BODCAW RURAL WATER SYSTEM	Administrative Order	1/6/2025	lic/RTCR
887	BODCAW RURAL WATER SYSTEM	Proposed Penalty	2/4/2025	lic/RTCR
653	BRANCH WATER WORKS	Warning of Administrative Order	6/3/2025	DBP
837	BRUNNER HILL WATER ASSOC	Warning of Administrative Order	7/2/2025	lic
737	BUENA VISTA-OGEMAW WATER ASSOCIATION	Administrative Order	3/6/2025	DBP
660	CASA WATER DEPT	Warning of Administrative Order	6/3/2025	DBP
660	CASA WATER DEPT	Administrative Order	9/11/2025	DBP/PN
845	CENTRAL LOGAN COUNTY PWFB	Administrative Order	3/6/2025	DBP
661	CHICOT JUNCTION WATER ASSOC	Warning of Administrative Order	3/6/2025	DBP
661	CHICOT JUNCTION WATER ASSOC	Administrative Order	6/3/2025	DBP
661	CHICOT JUNCTION WATER ASSOC	Proposed Penalty	9/11/2025	DBP
101	COMMUNITY WATER SYSTEM	Administrative Order	6/3/2025	SWTR
052	DECATUR WATERWORKS	Warning of Administrative Order	7/2/2025	SWTR sig def
367	DELL WATERWORKS	Warning of Administrative Order	5/5/2025	GWR
082	DERMOTT WATERWORKS	Warning of Administrative Order	3/25/2025	GWR
082	DERMOTT WATERWORKS	Administrative Order	5/5/2025	RTCR/GWR
082	DERMOTT WATERWORKS	Proposed Penalty	8/4/2025	GWR sig def/PN
768	EAST NEWTON COUNTY WATER ASSN	Warning of Administrative Order	11/24/2025	lic
567	ELKINS WATERWORKS	Warning of Administrative Order	3/25/2025	SWTR

Thursday, May 14, 2026

Appendix J

Appendix J - Enforcement Actions

358	FOUKE WATERWORKS	Proposed Penalty	8/4/2025	lic/RTCR/PN/GWR sigdef
357	GARLAND WATERWORKS	Proposed Penalty	1/6/2025	GWR
696	GREASY VALLEY WPFB LOGAN CO.	Warning of Administrative Order	3/6/2025	DBP
402	HARMONY GROVE WATER ASSOC	Warning of Administrative Order	7/1/2025	DBPR
546	HARMONY WATER ASSOCIATION	Warning of Administrative Order	3/6/2025	DBP
546	HARMONY WATER ASSOCIATION	Administrative Order	6/3/2025	DBP
546	HARMONY WATER ASSOCIATION	Proposed Penalty	9/11/2025	DBP
765	HWY 4 24 WATER ASSOCIATION	Warning of Administrative Order	9/11/2025	DBP
168	KELSO-ROHWER WATER ASSOCIATION	Warning of Administrative Order	9/11/2025	GWR
168	KELSO-ROHWER WATER ASSOCIATION	Administrative Order	11/24/2025	GWR
726	LAKESHORE ESTATES WATER ASSN	Proposed Penalty	2/4/2025	RTCR
214	LITTLE CREEK WATER ASSOCIATION	Warning of Administrative Order	11/24/2025	lic
343	LONOKE WATERWORKS	Administrative Order	1/6/2025	lic
343	LONOKE WATERWORKS	Proposed Penalty	2/4/2025	lic
152	MARION WATERWORKS	Warning of Administrative Order	11/24/2025	lic
136	MULBERRY WATERWORKS	Warning of Administrative Order	9/11/2025	DBP
697	NE YELL COUNTY WATER ASSOC	Warning of Administrative Order	7/1/2025	DBPR
175	NORTHERN OHIO WATER ASSOC	Warning of Administrative Order	1/6/2025	lic/RTCR
019	PARKDALE WATERWORKS	Warning of Administrative Order	8/4/2025	GWR sig def
019	PARKDALE WATERWORKS	Administrative Order	9/11/2025	GWR
019	PARKDALE WATERWORKS	Proposed Penalty	11/24/2025	GWR

Appendix J - Enforcement Actions

662	PARKIN RURAL WATER ASSOCIATION	Administrative Order	2/4/2025	lic
649	PENDLETON-PEA RIDGE WATER ASSN	Warning of Administrative Order	5/5/2025	RTCR
649	PENDLETON-PEA RIDGE WATER ASSN	Administrative Order	6/3/2025	RTCR
018	PORTLAND WATERWORKS	Warning of Administrative Order	8/4/2025	GWR sig def
018	PORTLAND WATERWORKS	Administrative Order	9/11/2025	GWR
329	RATCLIFF WATERWORKS	Warning of Administrative Order	9/11/2025	DBP
173	REED WATERWORKS	Administrative Order	5/21/2025	RTCR
219	SOUTH SHERIDAN WATER ASSOC	Warning of Administrative Order	11/24/2025	lic
889	SOUTHWEST ARKANSAS WATER SYST	Administrative Order	6/3/2025	DBP
889	SOUTHWEST ARKANSAS WATER SYST	Proposed Penalty	9/11/2025	DBP/PN
472	SUNSET WATER ASSOCIATION	Warning of Administrative Order	11/1/2025	lic
628	SW BOONE COUNTY WATER ASSOC	Warning of Administrative Order	7/2/2025	SWTR sig def
846	TRI COUNTY RWDD - MOORES CHAPEL	Proposed Penalty	3/6/2025	DBP
639	WALKERVILLE WATER ASSOCIATION	Warning of Administrative Order	1/6/2025	LCR/RTCR
639	WALKERVILLE WATER ASSOCIATION	Administrative Order	3/6/2025	RTCR/LCR
345	WARD WATERWORKS	Warning of Administrative Order	5/5/2025	lic
345	WARD WATERWORKS	Administrative Order	6/3/2025	lic
187	WILMAR WATERWORKS	Warning of Administrative Order	9/11/2025	GWR
187	WILMAR WATERWORKS	Administrative Order	11/24/2025	GWR

PWS type: N

PWS	System Name	Enforcement Action	Date Issued	Rule Violated
1155	BLUE BELL CAFE	Proposed Penalty	2/4/2025	RTCR/PN

Appendix J - Enforcement Actions

T1080	CITGO FOOD MART	Administrative Order	3/6/2025	RTCR/PN
T0931	T & A SALOON & IRON HORSE STABLES	Proposed Penalty	7/2/2025	RTCR/PN
T0399	THE OUTPOST	Proposed Penalty	2/4/2025	RTCR/GWR/PN

Appendix K - Systems with Public Notice Violations

PWS type: B

PWS	System Name	SDWIS Code	Violation Date	Retail population
N0136	CULLIGAN OF NORTHWEST ARKANSAS	75	10/1/2021	25

PWS type: C

PWS	System Name	SDWIS Code	Violation Date	Retail population
006	ALMYRA WATERWORKS	75	3/1/2023	349
271	ALTHEIMER WATERWORKS	75	4/1/2025	765
424	ANTOINE WATERWORKS	75	4/1/2024	563
068	BANKS WATERWORKS	75	8/1/2022	244
600	BELLEVILLE WATER	75	9/1/2024	1103
519	BEN LOMOND WATERWORKS	75	4/1/2019	210
887	BODCAW RURAL WATER SYSTEM	75	12/1/2024	1430
979	Bonanza Waterworks	75	5/1/2023	610
223	BRECKENRIDGE UNION WATER ASSOC	75	4/1/2023	1225
384	BRINKLEY WATERWORKS	75	3/1/2024	2992
737	BUENA VISTA-OGEMAW WATER	75	3/1/2025	445
261	CAMPBELL STATION WATERWORKS	75	4/1/2025	245
660	CASA WATER DEPT	75	6/1/2025	1500
647	CHESTER WATER WORK	75	4/1/2023	223
385	CLARENDON WATERWORKS	75	6/1/2025	1320
669	COMPTON WATERWORKS	75	11/1/2020	990
596	COTTON PLANT WATERWORKS	75	3/1/2016	435
813	COTTONWOOD WATER ASSOCIATION	75	1/1/2018	820
603	DANVILLE WATERWORKS	75	11/1/2022	2810
052	DECATUR WATERWORKS	75	7/1/2025	2468
423	DELIGHT WATERWORKS	75	5/1/2025	1577
082	DERMOTT WATERWORKS	75	7/1/2025	2604
450	DEVALLS BLUFF WATERWORKS	75	9/1/2021	600
715	EAST MONROE COUNTY WATER USERS	75	9/1/2019	730
046	FIFTY SIX WATERWORKS	75	9/1/2021	593
358	FOUKE WATERWORKS	75	12/1/2025	955
357	GARLAND WATERWORKS	75	11/1/2025	342
154	GILMORE WATERWORKS	75	6/1/2025	248
701	GREEN HILL-BROOKS CHAPEL WATER	75	4/1/2025	597
402	HARMONY GROVE WATER ASSOC	75	9/1/2015	2192
546	HARMONY WATER ASSOCIATION	75	3/1/2025	336

Thursday, May 14, 2026

Appendix K

Appendix K - Systems with Public Notice Violations

159	HICKORY RIDGE WATERWORKS	75	5/1/2022	424
388	HOLLY GROVE WATERWORKS	75	8/1/2020	1557
884	HOSANNA HEIGHTS WATER	75	1/1/2024	52
749	HWY 64 WATER ASSOCIATION	75	4/1/2024	215
774	INDEPENDENCE JACKSON REGIONAL	75	1/1/2024	2996
263	JACKSONPORT WATERWORKS	75	8/1/2022	233
168	KELSO-ROHWER WATER ASSOCIATION	75	10/1/2025	563
108	KINGSLAND WATERWORKS	75	5/1/2025	447
122	LAKE CITY WATERWORKS	75	12/1/2017	2186
677	LAKE FOREST SUBORDINATE DIST	75	1/1/2022	125
420	LAKE VIEW MUNICIPAL WATER	75	4/1/2022	665
726	LAKESHORE ESTATES WATER ASSN	75	10/1/2025	568
063	LEAD HILL WATERWORKS	75	3/1/2025	525
747	LEISURE HILLS MOBILE HOME PARK	75	10/1/2025	113
152	MARION WATERWORKS	75	12/1/2025	13032
042	MOCKINGBIRD HILL WATER ASSOC	75	8/1/2022	875
633	MUNDELL HEIGHTS WATERWORKS	75	1/1/2022	203
175	NORTHERN OHIO WATER ASSOC	75	1/1/2025	720
375	OSCEOLA WATERWORKS	75	12/1/2025	6053
580	PANGBURN WATERWORKS	75	4/1/2018	2936
019	PARKDALE WATERWORKS	75	12/1/2025	377
662	PARKIN RURAL WATER ASSOCIATION	75	3/1/2025	323
160	PARKIN WATERWORKS	75	1/1/2024	722
172	PICKENS WATERWORKS	75	9/1/2024	49
018	PORTLAND WATERWORKS	75	5/1/2022	625
354	PYATT WATERWORKS	75	2/1/2023	488
889	SOUTHWEST ARKANSAS WATER SYST	75	6/1/2025	2335
334	SUBIACO ACADEMY WATERWORKS	75	4/1/2016	250
882	SYLAMORE VALLEY WATER ASSN	75	8/1/2021	290
114	TAYLOR WATERWORKS	75	4/1/2025	566
155	TURRELL WATER WORKS	75	12/1/2025	540
065	VALLEY SPRINGS WATERWORKS	75	12/1/2024	3400
283	WABBASEKA WATERWORKS	75	4/1/2025	286
416	WEST HELENA WATER WORKS	75	12/1/2024	5673
400	WESTERN GROVE MUNICIPAL WATER	75	3/1/2024	930
187	WILMAR WATERWORKS	75	10/1/2025	400
196	WOOSTER WATERWORKS	75	12/1/2023	5000

Thursday, May 14, 2026

Appendix K

Appendix K - Systems with Public Notice Violations

383 YARBRO WATERWORKS 75 4/1/2024 392

PWS type: N

PWS	System Name	SDWIS Code	Violation Date	Retail population
1089	101 GROCERY	75	8/1/2019	25
T1066	24 HOUR FUEL 1013	75	9/1/2017	30
T1105	3B OFF ROAD, LLC	75	11/1/2022	25
1274	BIG FORK MALL	75	8/1/2025	25
1080	BIGGERS BED AND BREAKFAST	75	10/1/2024	25
1155	BLUE BELL CAFE	75	1/1/2025	25
T0083	BOGG SPRINGS BAPTIST CAMP	75	9/1/2023	800
T0091	BROOKHILL RANCH	75	7/1/2019	250
T0114	CAMP CANFIELD	75	9/1/2016	100
931	CEDAR RIDGE COUNTRY CUPBOARD	75	5/1/2024	25
T1080	CITGO FOOD MART	75	10/1/2024	250
T0269	FERNDALE MARKET	75	7/1/2019	25
T0215	FISH FIDDLE RESORT	75	11/1/2023	25
T0932	GASKINS CABIN STEAKHOUSE	75	9/1/2025	75
1253	HILLBILLY SLIMS	75	3/1/2024	25
945	HOT SPRINGS OFF-ROAD PARK	75	5/1/2018	80
1105	HOWARD COVE RV	75	4/1/2025	88
T0295	KELLER'S KOVE RESORT	75	8/1/2020	25
T0381	KWIK SERV	75	6/1/2023	500
T0312	LAKE LEATHERWOOD CAMPGROUND	75	6/1/2024	25
T0313	LAKE NORFORK RESORT	75	12/1/2024	25
T1090	LOST BRIDGE MARINA	75	6/1/2025	25
T0870	MILLWOOD LANDING GOLF & RV RESORT	75	7/1/2023	125
T0373	MOOSE LODGE 1953	75	4/1/2025	25
982	MULBERRY RIVER MOUNTAIN RANCH	75	10/1/2024	250
T1068	NORFORK LAKE ESTATES-MOHR ADD	75	5/1/2025	25
957	NORFORK MARINA	75	9/1/2024	25
T0326	OHANA CELEBRATION PARK	75	11/1/2016	70
T0406	OZARK REGULAR BAPTIST CAMP	75	11/1/2020	25
T1016	OZARKS RV RESORT OWNERS	75	12/1/2020	500
910	R&R COUNTRY STORE	75	9/1/2025	25
T1067	SHEPHERD OF THE OZARKS	75	7/1/2022	25
958	SOUTHFORK RESORT	75	9/1/2023	50

Thursday, May 14, 2026

Appendix K

Appendix K - Systems with Public Notice Violations

T0829	THE INN AT LOST BRIDGE	75	9/1/2022	25
T0322	THE LANGLEY STORE	75	10/1/2021	25
T0550	THREE OAKS RESORT	75	11/1/2025	25
855	TWIN OAKS MOBILE HOME PARK	75	9/1/2023	10
T0892	USCOE BWP29 STARKEY PARK	75	8/1/2024	25
T0810	USFS SHADY LAKE REC AREA 16661	75	12/1/2025	25
T1092	WOODSCAPE PROPERTIES LLC.	75	9/1/2022	25

PWS type: P

PWS	System Name	SDWIS Code	Violation Date	Retail population
1243	HAPPY FEET LEARNING CENTER	75	2/1/2025	42
731	RIVER BEND PARK POA	75	2/1/2025	1920
1123	WILSON GUN SHOP #2	75	11/1/2022	150

PWS type: V

PWS	System Name	SDWIS Code	Violation Date	Retail population
988	Brentwood Rest Area WVM	75	4/1/2023	30
N0186	CULLIGAN WATER CONDITIONING	75	8/1/2024	30
972	GENERAL WATER CONDITIONING	75	11/1/2023	30
1231	GLACIER HSF2217 HARRISON	75	7/1/2021	30
1096	GLACIER SMERC300 ROGERS	75	5/1/2018	30
1252	NATURAL PURE 1 HOLIDAY ISLAND	75	6/1/2023	30
1146	PRIMO ARKADELPHIA	75	7/1/2016	30
1236	PRIMO GLACIER OTW5 FAYETTEVILLE	75	1/1/2019	60
N0202	PRIMO HF119 SPRINGDALE	75	7/1/2018	30
N0175	PRIMO JONESBORO WAL-M128	75	5/1/2018	30
N0225	PRIMO NMKT2744 FT SMITH	75	10/1/2024	30
N0197	PRIMO WMNM 2471 BENTONVILLE	75	1/1/2019	30
N0229	PRIMO WMNM 3479 ROGERS	75	3/1/2018	30
1215	PRIMO WMNM3654 ROGERS	75	3/1/2018	30
1219	PRIMO WMNM4654 MARION	75	12/1/2023	80
1200	PRIMO WMNM6876 JONESBORO	75	5/1/2018	30
1199	PRIMO WMNM6943 JONESBORO	75	5/1/2018	30
N0158	PRIMO WMSC 0002 HARRISON	75	9/1/2013	30
N0157	PRIMO WMSC0001 ROGERS	75	3/1/2018	30
1049	PRIMO WMSC0007 SHERWOOD	75	5/1/2013	30
1145	PRIMO WMSC0062 BLYTHEVILLE	75	7/1/2018	30
N0233	PRIMO WMSC0066 CLARKSVILL	75	11/1/2017	30

Thursday, May 14, 2026

Appendix K

Appendix K - Systems with Public Notice Violations

N0151	PRIMO WMSC0070 WEST MEMPHIS	75	5/1/2018	30
N0164	PRIMO WMSC0071 POCAHONTAS	75	1/1/2025	30
1169	PRIMO WMSC0074 OSCEOLA	75	11/1/2017	30
N0191	PRIMO WMSC0124 LITTLE ROCK	75	5/1/2018	30
N0192	PRIMO WMSC0125 FT. SMITH	75	8/1/2013	30
1112	PRIMO WMSC0126 LITTLE ROCK	75	5/1/2018	30
N0160	PRIMO WMSC0145 JONESBORO	75	12/1/2018	30
921	PRIMO WMSC0279 DEQUEEN	75	5/1/2018	30
N0176	PRIMO WMSC0281 HEBER SPRINGS	75	4/1/2018	30
1017	PRIMO WMSC0388	75	12/1/2017	30
N0231	PRIMO WMSC0468 TEXARKANA	75	11/1/2017	30
983	PRIMO WMSC2587 CABOT	75	8/1/2018	30
1106	PRIMO WMSC2743 SHERWOOD	75	5/1/2012	30
1147	PRIMO WMSC348 MONTICELLO	75	4/1/2018	30
946	PRIMO WMSC5260 ROGERS	75	3/1/2018	30
1041	PRIMO-GLACER ONF FAYETTEVILLE	75	1/1/2019	30
1183	SPLASH CAR WASH MTN. VIEW	75	7/1/2025	30
T1106	WATER WAGON	75	2/1/2022	25

Appendix L - Systems who fail to submit a CCR

PWS type: C

PWS	System Name	SDWIS Code	Violation Date	RTC date	Retail population
282	ADC - TUCKER UNIT MAINT	71	7/1/2019		2000
058	ALPENA WATERWORKS	71	7/1/2025		568
271	ALTHEIMER WATERWORKS	71	7/1/2025		765
088	AMITY WATERWORKS	71	7/1/2021		506
790	AR DEPT OF CORRECTION IZARD CO	71	7/1/2025		907
085	ARKADELPHIA WATERWORKS	71	7/1/2025		11855
819	BASIN VALLEY WATER SYSTEM	71	7/1/2022	7/31/2025	513
622	BATTS-LAPILE WATER ASSOCIATION	71	7/1/2025		583
497	BAUXITE WATER	71	7/1/2020	5/22/2025	705
592	BEEBE WATERWORKS	71	7/1/2021		8451
059	BELLEFONTE WATER	71	7/1/2021		503
295	BUCKNER WATERWORKS	71	7/1/2021		290
261	CAMPBELL STATION WATERWORKS	71	7/1/2025		245
385	CLARENDON WATERWORKS	71	7/1/2025		1320
181	COLLINS WATER ASSOCIATION	71	7/1/2025		214
036	COMMUNITY WATER ASSOCIATION (SALESVILLE)	71	7/1/2025		715
096	CORNING WATERWORKS	71	7/1/2020		3388
596	COTTON PLANT WATERWORKS	71	7/1/2016		435
596	COTTON PLANT WATERWORKS	71	7/1/2015		435
596	COTTON PLANT WATERWORKS	71	7/1/2025		435
180	CROWLEYS RIDGE WATER ASSOC	71	7/1/2021		3873
670	DEER WATER ASSOCIATION	71	7/1/2025		938
082	DERMOTT WATERWORKS	71	7/1/2025		2604
450	DEVALLS BLUFF WATERWORKS	71	7/1/2021		600
171	DUMAS WATERWORKS	71	7/1/2025		6338
150	EARLE WATERWORKS	71	7/1/2025		1659

Thursday, May 21, 2026

Appendix L

Appendix L - Systems who fail to submit a CCR

715	EAST MONROE COUNTY WATER USERS	71	7/1/2025		730
768	EAST NEWTON COUNTY WATER ASSN	71	7/1/2025		1920
768	EAST NEWTON COUNTY WATER ASSN	71	7/1/2021		1920
323	FOREMAN WATERWORKS	71	7/1/2025		1011
358	FOUKE WATERWORKS	71	7/1/2025		955
586	FOUR MILE HILL PUBLIC FACILITIES BOARD	71	7/1/2025		4877
636	FRENCHPORT WATER ASSOCIATION	71	7/1/2020		1793
357	GARLAND WATERWORKS	71	7/1/2021		342
357	GARLAND WATERWORKS	71	7/1/2025		342
154	GILMORE WATERWORKS	71	7/1/2025		248
857	GLEN ACRES	71	7/1/2025		68
374	GOSNELL WATER ASSOCIATION	71	7/1/2025		3083
419	HELENA WATER SEWER	71	7/1/2025		2708
884	HOSANNA HEIGHTS WATER	71	7/1/2025		52
301	HOXIE WATER DEPARTMENT	71	7/1/2021		2666
749	HWY 64 WATER ASSOCIATION	71	7/1/2025		215
640	JOHNSON TOWNSHIP WATER ASSOC	71	7/1/2025		600
377	JOINER RURAL WATER	71	7/1/2018	2/24/2026	343
552	JUNCTION CITY WATERWORKS	71	7/1/2020		726
168	KELSO-ROHWER WATER ASSOCIATION	71	7/1/2020	4/29/2026	563
168	KELSO-ROHWER WATER ASSOCIATION	71	7/1/2025		563
677	LAKE FOREST SUBORDINATE DIST	71	7/1/2021		125
420	LAKE VIEW MUNICIPAL WATER	71	7/1/2019		665
420	LAKE VIEW MUNICIPAL WATER	71	7/1/2020		665
420	LAKE VIEW MUNICIPAL WATER	71	7/1/2025		665
726	LAKESHORE ESTATES WATER ASSN	71	7/1/2025		568
063	LEAD HILL WATERWORKS	71	7/1/2025	3/13/2026	525
747	LEISURE HILLS MOBILE HOME PARK	71	7/1/2021		113

Thursday, May 21, 2026

Appendix L

Appendix L - Systems who fail to submit a CCR

214	LITTLE CREEK WATER ASSOCIATION	71	7/1/2019		2561
274	LONG LAKE WATER ASSOCIATION	71	7/1/2025		188
430	MARKED TREE WATERWORKS	71	7/1/2025		2610
599	MC CRORY WATERWORKS	71	7/1/2025		1736
153	MIDWAY WATER ASSOCIATION	71	7/1/2025		1899
014	MONTROSE / BOYDELL WATER SYSTEM	71	7/1/2025		473
141	MOUNTAINBURG WATER AND SEWER	71	7/1/2021		1052
557	NEW LONDON WATER ASSOCIATION	71	7/1/2025		850
767	NORTH JACKSON CO RURAL WATER ASSN	71	7/1/2025		807
767	NORTH JACKSON CO RURAL WATER ASSN	71	7/1/2021		807
247	OIL TROUGH WATERWORKS	71	7/1/2021		235
375	OSCEOLA WATERWORKS	71	7/1/2025		6053
1078	OZAN CREEK RURAL WATER SYSTEM	71	7/1/2025		787
019	PARKDALE WATERWORKS	71	7/1/2025		377
598	PATTERSON WATERWORKS	71	7/1/2021		445
053	PEA RIDGE WATERWORKS	71	7/1/2021		12795
649	PENDLETON-PEA RIDGE WATER ASSN	71	7/1/2019	5/13/2025	845
649	PENDLETON-PEA RIDGE WATER ASSN	71	7/1/2020	5/13/2025	845
172	PICKENS WATERWORKS	71	7/1/2025		49
121	PLUMERVILLE WATERWORKS	71	7/1/2025		1440
474	POCAHONTAS WATERWORKS	71	7/1/2021		7752
018	PORTLAND WATERWORKS	71	7/1/2025		625
477	RAVENDEN SPRINGS WATERWORKS	71	7/1/2025		139
106	RISON WATERWORKS	71	7/1/2025		1344
833	RIVER VALLEY WATER ASSN	71	7/1/2025		1207
591	RUSSELL WATERWORKS	71	7/1/2021		461
594	SE WHITE COUNTY WATER ASSOC	71	7/1/2021		5018
182	SELMA WATER ASSOCIATION	71	7/1/2025		1600

Thursday, May 21, 2026

Appendix L

Appendix L - Systems who fail to submit a CCR

293	SPADRA-GOOSE CAMP WATER ASSOC	71	7/1/2025		517
556	STRONG WATERWORKS	71	7/1/2025		1131
114	TAYLOR WATERWORKS	71	7/1/2025		566
266	TUCKERMAN WATERWORKS	71	7/1/2021		1817
155	TURRELL WATER WORKS	71	7/1/2025		540
654	UNITED WATER ASSOCIATION	71	7/1/2025		450
283	WABBASEKA WATERWORKS	71	7/1/2025		286
309	WALNUT RIDGE WATERWORKS	71	7/1/2021	11/24/2025	5823
416	WEST HELENA WATER WORKS	71	7/1/2025		5693
779	WEST WOODRUFF WATER DISTRICT	71	7/1/2021		398
529	WILLIFORD WATERWORKS	71	7/1/2021	4/29/2026	80
529	WILLIFORD WATERWORKS	71	7/1/2025		80
321	WILTON WATERWORKS	71	7/1/2025		354